



Air Conditioning & Heating

DSZC16

COOLING CAPACITY: 24,000 - 60,000 BTU/H

HEATING CAPACITY: 24,000 - 60,000 BTU/H

SPLIT SYSTEM HEAT PUMP UP TO 16 SEER & 9.5 HSPF



ComfortNet™



Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps must be matched with appropriate coil components to meet ENERGY STAR® criteria. Ask your contractor for details or visit www.energystar.gov.

Contents

Nomenclature.....	2
Product Specifications.....	3
Expanded Cooling Data.....	4
Expanded Heating Data.....	20
AHRI Ratings.....	22
Dimensions.....	29
Wiring Diagram.....	30
Accessories.....	31

Standard Features

- Two-Stage Copeland® UltraTech™ scroll compressor
- High-density foam compressor sound blanket
- ComfortNet™ Communications System compatible
- Expanded ComfortAlert™ diagnostics built in
- Set-up capable with two low-voltage wires to outdoor unit
- Diagnostic indicator lights and storage of six fault codes
- Color-coded terminal strip for non-communicating set-up
- SmartShift® technology to ensure quiet, reliable defrost
- Factory-installed bi-flow liquid-line filter drier
- Factory-installed suction-line accumulator
- Factory-installed compressor crankcase heater
- Factory-installed high-capacity muffler
- Factory-installed coil and ambient temperature sensors
- High- and low-pressure switches
- Fully charged for 15' of tubing length
- Two-speed quiet condenser fan motor
- Sweat connection service valves with easy access to gauge ports
- AHRI Certified; ETL Listed

Cabinet Features

- Goodman® brand sound control top design
- Heavy-gauge galvanized-steel cabinet
- Appliance-quality powder-paint finish with 500-hour salt-spray approval
- Wire fan discharge grille
- Steel louver coil guard
- Rust-resistant coated screws
- Compact footprint
- Top and side maintenance access
- Single-panel access to controls with space provided for field-installed accessories
- When properly anchored, meets 2010 Florida Building Code unit integrity requirements for hurricane-type winds (Anchor bracket kits available.)

LIFETIME
COMPRESSOR
LIMITED WARRANTY

10 UNIT
REPLACEMENT
LIMITED
WARRANTY

10 PARTS
LIMITED
WARRANTY








COMPANY WITH
QUALITY SYSTEM
CERTIFIED BY DNV GL
= ISO 9001 =

COMPANY WITH
ENVIRONMENTAL SYSTEM
CERTIFIED BY DNV GL
= ISO 14001 =

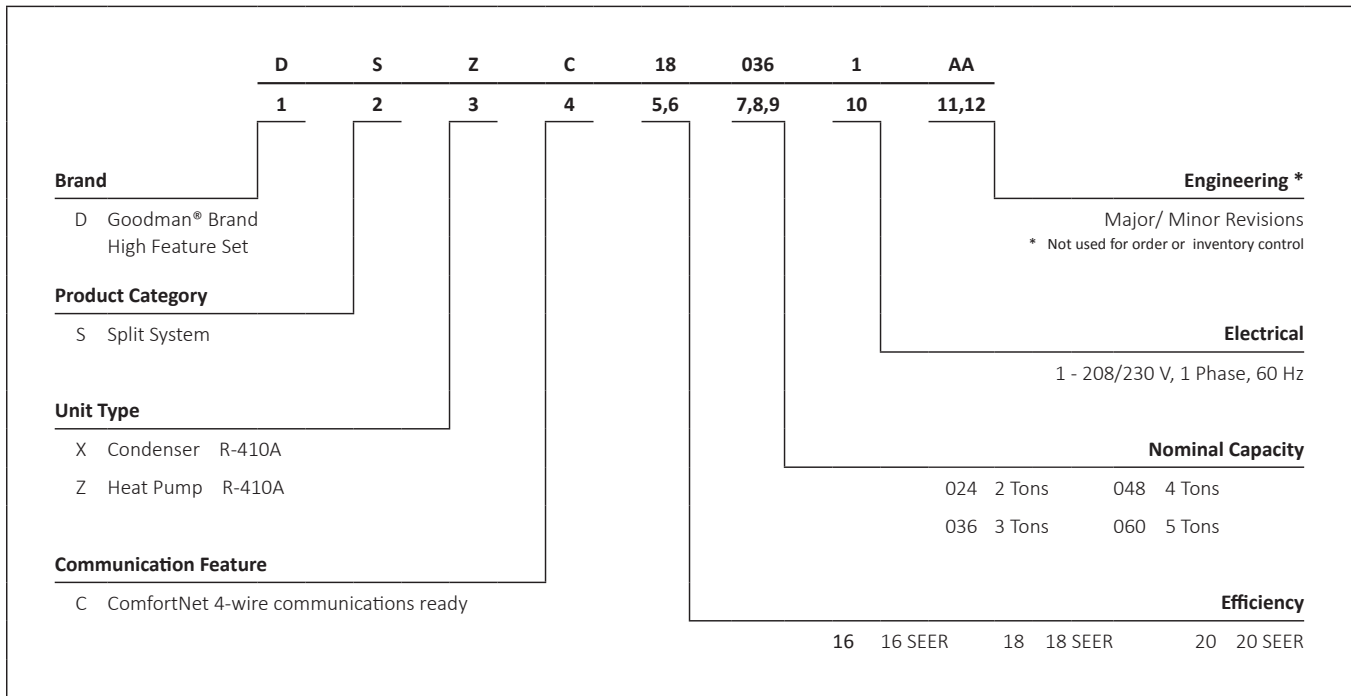

* Complete warranty details available from your local dealer or at www.goodmanmfg.com. To receive the Lifetime Compressor Limited Warranty (good for as long as you own your home), 10-Year Unit Limited Warranty, and 10-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Online registration is not required in California or Québec.



	DSZC16 0241A	DSZC16 0361A	DSZC16 0481A	DSZC16 0601B
CAPACITIES AND RATINGS				
Nominal Cooling (BTU/h)	24,000	36,000	48,000	60,000
Nominal Heating (BTU/h)	24,000	36,000	48,000	60,000
Decibels	72	73	74	75
COMPRESSOR				
RLA	11.7	15.3	21.2	28.8
LRA	58.3	83.0	104.0	152.9
CONDENSER FAN MOTOR				
Horsepower	1/6	1/6	1/6	1/6
FLA	1.2	1.2	1.2	1.2
REFRIGERATION SYSTEM				
Refrigerant Line Size ¹				
Liquid Line Size ("O.D.)	3/8"	3/8"	3/8"	3/8"
Suction Line Size ("O.D.)	3/4"	7/8"	1 1/8"	1 1/8"
Refrigerant Connection Size				
Liquid Valve Size ("O.D.)	3/8"	3/8"	3/8"	3/8"
Suction Valve Size ("O.D.)	3/4"	7/8"	7/8"	7/8"
Valve Connection Type	Sweat	Sweat	Sweat	Sweat
Refrigerant Charge (oz.)	153	203	263	273
Shipped with Orifice Size	NA	NA	NA	NA
ELECTRICAL DATA				
Volts -Hz	208/230-60	208/230-60	208/230-60	208/230-60
Minimum Circuit Ampacity ²	15.8	20.3	27.7	37.2
Max. Overcurrent Protection ³	25	35	45	60
Min / Max Volts	197/253	197/253	197/253	197/253
Power Supply Conduit Size	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"
UNIT WEIGHTS				
Equipment Weight	190	233	305	309
Ship Weight (lbs)	208	255	327	331
ENERGY STAR CERTIFIED [^]				
				

[^] Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps must be matched with appropriate coil components to meet ENERGY STAR® criteria. Ask your contractor for details or visit www.energystar.gov. The www.energystar.gov website provides up-to-date system combinations certified to meet ENERGY STAR requirements. See Page 22 for all ENERGY STAR-certified combinations as of this document's revision date.

¹ Tested and rated in accordance with AHRI Standard 210/240

² Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes

³ Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

NOTES

- Always check the rating plate for electrical data on the unit being installed.
- Installer will need to supply 3/8" to 1 1/8" adapters for suction line connections.
- Unit is charged with refrigerant for 15' of 3/8" liquid line. System charge must be adjusted per Installation Instructions Final Charge Procedure.
- Installation of these units requires the specified TXV Kit to be installed on the indoor coil.
THE SPECIFIED TXV IS DETERMINED BY THE OUTDOOR UNIT, NOT THE INDOOR COIL.

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	17.7	18.3	20.1	-	17.3	17.9	19.6	-	16.9	17.5	19.2	-	16.5	17.1	18.7	-	15.6	16.2	17.8	-	14.5	15.0	16.5	-
	S/T	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.84	0.70	0.48	-	0.86	0.72	0.50	-	0.90	0.75	0.52	-	0.90	0.76	0.52	-
	ΔT	18	15	12	-	18	15	12	-	18	15	12	-	18	15	12	-	18	15	12	-	16	14	11	-
	kW	1.06	1.09	1.12	-	1.15	1.17	1.21	-	1.22	1.25	1.29	-	1.29	1.32	1.36	-	1.34	1.37	1.42	-	1.39	1.42	1.47	-
	Amps	4.2	4.3	4.4	-	4.5	4.6	4.8	-	4.9	5.0	5.2	-	5.2	5.3	5.5	-	5.6	5.7	5.9	-	5.9	6.0	6.2	-
	Hi PR	209	225	237	-	235	252	266	-	267	287	303	-	304	327	345	-	342	368	388	-	378	406	429	-
	Lo PR	113	121	132	-	120	127	139	-	124	132	144	-	131	139	152	-	137	146	159	-	142	151	164	-
	MBh	17.2	17.8	19.5	-	16.8	17.4	19.1	-	16.4	17.0	18.6	-	16.0	16.6	18.2	-	15.2	15.7	17.2	-	14.1	14.6	16.0	-
	S/T	0.75	0.63	0.43	-	0.78	0.65	0.45	-	0.80	0.67	0.46	-	0.82	0.69	0.48	-	0.86	0.71	0.50	-	0.86	0.72	0.50	-
	ΔT	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	18	15	12	-
kW	1.06	1.08	1.11	-	1.14	1.16	1.20	-	1.21	1.24	1.28	-	1.28	1.31	1.35	-	1.33	1.36	1.41	-	1.38	1.41	1.46	-	
Amps	4.1	4.2	4.4	-	4.5	4.6	4.7	-	4.8	5.0	5.1	-	5.2	5.3	5.5	-	5.5	5.6	5.8	-	5.8	6.0	6.2	-	
Hi PR	207	223	235	-	232	250	264	-	264	284	300	-	301	324	342	-	338	364	384	-	374	402	425	-	
Lo PR	112	119	130	-	118	126	138	-	123	131	143	-	129	138	150	-	136	144	157	-	140	149	163	-	
MBh	16.3	16.9	18.5	-	15.9	16.5	18.1	-	15.6	16.1	17.7	-	15.2	15.7	17.2	-	14.4	15.0	16.4	-	13.4	13.9	15.2	-	
S/T	0.72	0.60	0.42	-	0.75	0.62	0.43	-	0.77	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.83	0.69	0.48	-	
ΔT	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	18	15	12	-	
kW	1.04	1.06	1.10	-	1.12	1.14	1.18	-	1.19	1.22	1.26	-	1.26	1.28	1.33	-	1.31	1.34	1.38	-	1.36	1.39	1.43	-	
Amps	4.1	4.2	4.3	-	4.4	4.5	4.6	-	4.8	4.9	5.0	-	5.1	5.2	5.4	-	5.4	5.5	5.7	-	5.7	5.9	6.1	-	
Hi PR	203	218	230	-	228	245	259	-	259	278	294	-	295	317	335	-	332	357	377	-	366	394	416	-	
Lo PR	110	117	128	-	116	124	135	-	121	128	140	-	127	135	147	-	133	141	154	-	137	146	160	-	

75	MBh	18.0	18.5	20.1	21.5	17.6	18.1	19.6	21.0	17.2	17.7	19.1	20.5	16.7	17.2	18.7	20.0	15.9	16.4	17.7	19.0	14.7	15.2	16.4	17.6
	S/T	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.95	0.85	0.64	0.41	0.98	0.88	0.67	0.43	1.00	0.91	0.69	0.44	1.00	0.92	0.70	0.45
	ΔT	20	19	15	11	21	19	15	11	21	19	15	11	21	19	16	11	20	19	15	11	19	18	14	10
	kW	1.07	1.10	1.13	1.17	1.16	1.18	1.22	1.26	1.23	1.26	1.30	1.35	1.30	1.33	1.37	1.42	1.36	1.39	1.43	1.48	1.40	1.44	1.48	1.54
	Amps	4.2	4.3	4.5	4.6	4.6	4.7	4.8	5.0	4.9	5.1	5.2	5.4	5.3	5.4	5.6	5.8	5.6	5.7	5.9	6.2	5.9	6.1	6.3	6.5
	Hi PR	211	227	240	250	237	255	269	281	269	290	306	319	307	330	349	364	345	372	392	409	381	410	433	452
	Lo PR	114	122	133	142	121	129	140	150	126	134	146	155	132	140	153	163	138	147	161	171	143	152	166	177
	MBh	17.5	18.0	19.5	20.9	17.1	17.6	19.0	20.4	16.7	17.2	18.6	19.9	16.3	16.7	18.1	19.4	15.4	15.9	17.2	18.5	14.3	14.7	15.9	17.1
	S/T	0.85	0.76	0.58	0.37	0.89	0.79	0.60	0.39	0.91	0.81	0.61	0.40	0.94	0.84	0.63	0.41	0.97	0.87	0.66	0.42	0.98	0.88	0.66	0.43
	ΔT	22	20	16	11	22	20	16	11	22	20	16	11	22	20	17	11	22	20	16	11	20	19	15	11
kW	1.06	1.09	1.12	1.16	1.15	1.17	1.21	1.25	1.22	1.25	1.29	1.34	1.29	1.32	1.36	1.41	1.34	1.37	1.42	1.47	1.39	1.42	1.47	1.52	
Amps	4.2	4.3	4.4	4.6	4.5	4.6	4.8	4.9	4.9	5.0	5.2	5.4	5.2	5.3	5.5	5.7	5.6	5.7	5.9	6.1	5.9	6.0	6.2	6.5	
Hi PR	209	225	238	248	235	252	267	278	267	287	303	316	304	327	345	360	342	368	388	405	378	406	429	448	
Lo PR	113	121	132	140	120	127	139	148	124	132	144	154	131	139	152	162	137	146	159	169	142	151	165	175	
MBh	16.6	17.1	18.5	19.9	16.2	16.7	18.1	19.4	15.8	16.3	17.6	18.9	15.4	15.9	17.2	18.5	14.7	15.1	16.3	17.5	13.6	14.0	15.1	16.3	
S/T	0.82	0.73	0.55	0.36	0.85	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.41	0.94	0.84	0.64	0.41	
ΔT	22	20	17	11	22	20	17	12	22	20	17	12	22	21	17	12	22	20	17	12	21	19	16	11	
kW	1.05	1.07	1.10	1.14	1.13	1.15	1.19	1.23	1.20	1.23	1.27	1.31	1.27	1.29	1.34	1.38	1.32	1.35	1.40	1.44	1.37	1.40	1.45	1.50	
Amps	4.1	4.2	4.3	4.5	4.4	4.5	4.7	4.9	4.8	4.9	5.1	5.3	5.1	5.3	5.4	5.6	5.5	5.6	5.8	6.0	5.8	5.9	6.1	6.3	
Hi PR	205	220	233	243	230	247	261	272	261	281	297	310	298	320	338	353	335	360	381	397	370	398	421	439	
Lo PR	111	118	129	137	117	125	136	145	122	130	142	151	128	136	149	158	134	143	156	166	139	148	161	172	

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (compressor + fan)

IDB		OUTDOOR AMBIENT TEMPERATURE												115°F																	
		65°F						75°F						85°F						95°F						105°F					
		59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79
80	MBh	18.3	18.7	20.0	21.4	17.9	18.3	19.5	20.9	17.5	17.8	19.1	20.4	17.0	17.4	18.6	19.9	16.2	16.5	17.7	18.9	15.0	15.3	16.4	17.5						
	S/T	1.00	0.92	0.75	0.56	1.00	0.95	0.78	0.58	1.00	1.00	0.80	0.60	1.00	1.00	0.82	0.61	1.00	1.00	0.85	0.64	1.00	1.00	0.86	0.64						
	ΔT	23	22	19	15	22	22	19	15	22	22	19	15	21	22	19	15	20	21	19	15	19	19	18	14						
	kW	1.08	1.11	1.14	1.18	1.17	1.19	1.23	1.27	1.24	1.27	1.31	1.36	1.31	1.34	1.38	1.43	1.37	1.40	1.45	1.50	1.42	1.45	1.50	1.55						
	Amps	4.3	4.4	4.5	4.7	4.6	4.7	4.9	5.0	5.0	5.1	5.3	5.5	5.3	5.4	5.6	5.8	5.7	5.8	6.0	6.2	6.0	6.1	6.3	6.6						
	Hi PR	213	229	242	253	239	258	272	284	272	293	309	323	310	334	352	367	349	375	396	413	385	415	438	457						
	Lo PR	116	123	134	143	122	130	142	151	127	135	147	157	133	142	155	165	140	149	162	173	145	154	168	179						
	MBh	17.8	18.2	19.4	20.8	17.4	17.8	19.0	20.3	17.0	17.3	18.5	19.8	16.5	16.9	18.1	19.3	15.7	16.1	17.2	18.3	14.6	14.9	15.9	17.0						
	S/T	0.94	0.88	0.72	0.53	0.97	0.91	0.74	0.55	1.00	0.93	0.76	0.57	1.00	0.96	0.78	0.59	1.00	1.00	0.81	0.61	1.00	1.00	0.82	0.61						
	ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	24	20	16	23	23	20	16	21	21	19	15						
kW	1.07	1.10	1.13	1.17	1.16	1.18	1.22	1.26	1.23	1.26	1.30	1.35	1.30	1.33	1.37	1.42	1.36	1.39	1.43	1.48	1.40	1.44	1.48	1.54							
Amps	4.2	4.3	4.5	4.6	4.6	4.7	4.8	5.0	4.9	5.1	5.2	5.4	5.3	5.4	5.6	5.8	5.6	5.7	5.9	6.2	5.9	6.1	6.3	6.5							
Hi PR	211	227	240	250	237	255	269	281	269	290	306	319	307	330	349	364	345	372	392	409	381	411	433	452							
Lo PR	114	122	133	142	121	129	140	150	126	134	146	155	132	140	153	163	138	147	161	171	143	152	166	177							
MBh	16.9	17.3	18.4	19.7	16.5	16.9	18.0	19.3	16.1	16.5	17.6	18.8	15.7	16.1	17.2	18.3	14.9	15.3	16.3	17.4	13.8	14.1	15.1	16.1							
S/T	0.90	0.84	0.69	0.51	0.93	0.87	0.71	0.53	0.95	0.89	0.73	0.54	0.98	0.92	0.75	0.56	1.02	0.96	0.78	0.58	1.03	0.97	0.79	0.59							
ΔT	25	23	20	16	25	24	21	17	25	24	21	17	25	24	21	17	25	24	21	16	23	22	19	15							
kW	1.06	1.08	1.11	1.15	1.14	1.16	1.20	1.24	1.21	1.24	1.28	1.32	1.28	1.31	1.35	1.40	1.33	1.36	1.41	1.46	1.38	1.41	1.46	1.51							
Amps	4.1	4.2	4.4	4.5	4.5	4.6	4.7	4.9	4.8	5.0	5.1	5.3	5.2	5.3	5.5	5.7	5.5	5.6	5.8	6.0	5.8	6.0	6.2	6.4							
Hi PR	207	223	235	245	232	250	264	275	264	284	300	313	301	324	342	356	338	364	384	401	374	402	425	443							
Lo PR	112	119	130	139	118	126	138	147	123	131	143	152	129	138	150	160	136	144	157	168	140	149	163	173							
85	MBh	18.6	19.0	19.9	21.2	18.2	18.6	19.4	20.7	17.8	18.1	19.0	20.2	17.3	17.7	18.5	19.7	16.5	16.8	17.6	18.8	15.3	15.6	16.3	17.4						
	S/T	1.00	0.99	0.90	0.73	1.00	1.00	0.93	0.75	1.00	1.00	0.95	0.77	1.00	1.00	0.98	0.80	1.00	1.00	0.83	0.83	1.00	1.00	0.84							
	ΔT	23	24	22	19	23	23	23	20	22	23	23	20	22	22	23	20	21	21	22	20	19	20	20	18						
	kW	1.09	1.11	1.15	1.19	1.18	1.20	1.24	1.29	1.25	1.28	1.32	1.37	1.32	1.35	1.40	1.44	1.38	1.41	1.46	1.51	1.43	1.46	1.51	1.56						
	Amps	4.3	4.4	4.5	4.7	4.6	4.7	4.9	5.1	5.0	5.1	5.3	5.5	5.4	5.5	5.7	5.9	5.7	5.8	6.0	6.3	6.0	6.2	6.4	6.6						
	Hi PR	215	232	245	255	242	260	275	286	275	296	312	326	313	337	356	371	352	379	400	417	389	419	442	461						
	Lo PR	117	124	136	144	123	131	143	153	128	136	149	159	135	143	156	167	141	150	164	175	146	155	170	181						
	MBh	18.1	18.4	19.3	20.6	17.7	18.0	18.9	20.1	17.3	17.6	18.4	19.7	16.8	17.2	18.0	19.2	16.0	16.3	17.1	18.2	14.8	15.1	15.8	16.9						
	S/T	0.98	0.95	0.86	0.69	1.00	0.98	0.89	0.72	1.00	1.00	0.91	0.74	1.00	1.00	0.94	0.76	1.00	1.00	0.97	0.79	1.00	1.00	0.98	0.80						
	ΔT	26	25	24	21	26	26	24	21	25	25	24	21	24	25	24	21	23	24	24	21	21	22	22	19						
kW	1.08	1.11	1.14	1.18	1.17	1.19	1.23	1.27	1.24	1.27	1.31	1.36	1.31	1.34	1.38	1.43	1.37	1.40	1.45	1.50	1.42	1.45	1.50	1.55							
Amps	4.3	4.4	4.5	4.7	4.6	4.7	4.9	5.0	5.0	5.1	5.3	5.5	5.3	5.4	5.6	5.8	5.7	5.8	6.0	6.2	6.0	6.1	6.3	6.6							
Hi PR	213	229	242	253	239	258	272	284	272	293	309	323	310	334	352	367	349	375	396	413	385	415	438	457							
Lo PR	116	123	134	143	122	130	142	151	127	135	147	157	133	142	155	165	140	149	162	173	145	154	168	179							
MBh	17.2	17.5	18.4	19.6	16.8	17.1	17.9	19.1	16.4	16.7	17.5	18.7	16.0	16.3	17.1	18.2	15.2	15.5	16.2	17.3	14.1	14.3	15.0	16.0							
S/T	0.94	0.91	0.82	0.66	0.98	0.94	0.85	0.69	1.00	0.96	0.87	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.94	0.76							
ΔT	26.1	26	24	21	26	26	25	21	26	26	25	21	26	26	25	21	25	25	24	21	23	23	23	20							
kW	1.06	1.09	1.12	1.16	1.15	1.17	1.21	1.25	1.22	1.25	1.29	1.33	1.29	1.32	1.36	1.41	1.34	1.37	1.42	1.47	1.39	1.42	1.47	1.52							
Amps	4.2	4.3	4.4	4.6	4.5	4.6	4.8	4.9	4.9	5.0	5.2	5.4	5.2	5.3	5.5	5.7	5.6	5.7	5.9	6.1	5.9	6.0	6.2	6.5							
Hi PR	209	225	237	248	235	252	266	278	267	287	303	316	304	327	345	360	342	368	388	405	378	406	429	448							
Lo PR	113	121	132	140	120	127	139	148	124	132	144	154	131	139	152	162	137	146	159	169	142	151	164	175							

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (compressor + fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																								
		65°F				75°F				85°F				95°F				105°F				115°F				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
70	984	MBh	23.5	24.4	26.7	-	23.0	23.8	26.1	-	22.4	23.2	25.5	-	21.9	22.7	24.8	-	20.8	21.5	23.6	-	19.3	20.0	21.9	-
		S/T	0.80	0.66	0.46	-	0.82	0.69	0.48	-	0.85	0.71	0.49	-	0.87	0.73	0.51	-	0.91	0.76	0.52	-	0.91	0.76	0.53	-
		ΔT	17	15	11	-	18	15	12	-	18	15	12	-	18	15	12	-	18	15	12	-	16	14	11	-
		kW	1.56	1.60	1.65	-	1.68	1.72	1.78	-	1.79	1.83	1.90	-	1.89	1.93	2.00	-	1.97	2.02	2.09	-	2.04	2.09	2.16	-
		Amps	6.0	6.1	6.3	-	6.5	6.6	6.8	-	7.0	7.2	7.4	-	7.5	7.7	7.9	-	8.0	8.2	8.5	-	8.5	8.7	9.0	-
	Hi PR	223	240	253	-	250	269	284	-	284	306	323	-	324	349	368	-	365	392	414	-	403	433	458	-	
	Lo PR	111	118	129	-	117	125	136	-	122	130	142	-	128	136	149	-	134	143	156	-	139	148	161	-	
	MBh	22.8	23.7	25.9	-	22.3	23.1	25.3	-	21.8	22.6	24.7	-	21.2	22.0	24.1	-	20.2	20.9	22.9	-	18.7	19.4	21.2	-	
	S/T	0.76	0.63	0.44	-	0.79	0.66	0.46	-	0.81	0.67	0.47	-	0.83	0.70	0.48	-	0.86	0.72	0.50	-	0.87	0.73	0.50	-	
	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-	
kW	1.55	1.58	1.63	-	1.67	1.71	1.76	-	1.78	1.82	1.88	-	1.87	1.92	1.98	-	1.96	2.00	2.07	-	2.03	2.07	2.14	-		
Amps	5.9	6.1	6.3	-	6.4	6.6	6.8	-	7.0	7.1	7.4	-	7.4	7.6	7.9	-	7.9	8.1	8.4	-	8.4	8.6	8.9	-		
Hi PR	221	238	251	-	248	267	281	-	282	303	320	-	321	345	365	-	361	388	410	-	399	429	453	-		
Lo PR	110	117	128	-	116	124	135	-	121	128	140	-	127	135	147	-	133	141	154	-	137	146	160	-		
MBh	21.1	21.8	23.9	-	20.6	21.3	23.4	-	20.1	20.8	22.8	-	19.6	20.3	22.3	-	18.6	19.3	21.1	-	17.3	17.9	19.6	-		
S/T	0.73	0.61	0.42	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.70	0.48	-	0.84	0.70	0.49	-		
ΔT	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	17	15	11	-		
kW	1.51	1.54	1.59	-	1.63	1.67	1.72	-	1.73	1.77	1.83	-	1.83	1.87	1.93	-	1.91	1.95	2.01	-	1.97	2.02	2.09	-		
Amps	5.8	5.9	6.1	-	6.2	6.4	6.6	-	6.8	6.9	7.2	-	7.2	7.4	7.6	-	7.7	7.9	8.1	-	8.1	8.3	8.6	-		
Hi PR	214	230	243	-	240	259	273	-	273	294	310	-	311	335	354	-	350	377	398	-	387	416	440	-		
Lo PR	107	113	124	-	113	120	131	-	117	125	136	-	123	131	143	-	129	137	150	-	133	142	155	-		

75	984	MBh	23.9	24.6	26.7	28.6	23.4	24.1	26.0	27.9	22.8	23.5	25.4	27.3	22.2	22.9	24.8	26.6	21.1	21.8	23.6	25.3	19.6	20.2	21.8	23.4
		S/T	0.90	0.81	0.61	0.39	0.94	0.84	0.63	0.41	0.96	0.86	0.65	0.42	0.99	0.89	0.67	0.43	1.00	0.92	0.70	0.45	1.00	0.93	0.70	0.45
		ΔT	20	19	15	11	20	19	15	11	20	19	15	11	21	19	16	11	20	19	15	11	18	17	14	10
		kW	1.57	1.61	1.66	1.72	1.70	1.74	1.79	1.85	1.81	1.85	1.91	1.98	1.91	1.95	2.02	2.08	1.99	2.03	2.10	2.18	2.06	2.11	2.18	2.26
		Amps	6.0	6.2	6.4	6.6	6.5	6.7	6.9	7.2	7.1	7.3	7.5	7.8	7.6	7.8	8.0	8.3	8.1	8.3	8.5	8.9	8.5	8.7	9.0	9.4
	Hi PR	225	242	256	267	253	272	287	300	287	309	327	341	327	352	372	388	368	396	418	436	407	438	462	482	
	Lo PR	112	119	130	139	119	126	138	147	123	131	143	152	129	138	150	160	136	144	157	168	140	149	163	173	
	MBh	23.2	23.9	25.9	27.8	22.7	23.4	25.3	27.1	22.1	22.8	24.7	26.5	21.6	22.2	24.1	25.8	20.5	21.1	22.9	24.5	19.0	19.6	21.2	22.7	
	S/T	0.86	0.77	0.58	0.38	0.89	0.80	0.61	0.39	0.92	0.82	0.62	0.40	0.95	0.85	0.64	0.41	0.98	0.88	0.67	0.43	0.99	0.89	0.67	0.43	
	ΔT	21	19	16	11	21	20	16	11	21	20	16	11	21	20	16	11	21	20	16	11	20	18	15	10	
kW	1.56	1.60	1.65	1.70	1.68	1.72	1.78	1.84	1.79	1.83	1.90	1.96	1.89	1.93	2.00	2.07	1.97	2.02	2.09	2.16	2.04	2.09	2.16	2.24		
Amps	6.0	6.1	6.3	6.6	6.5	6.6	6.8	7.1	7.0	7.2	7.4	7.7	7.5	7.7	7.9	8.2	8.0	8.2	8.5	8.8	8.5	8.7	9.0	9.3		
Hi PR	223	240	253	264	250	269	284	297	285	306	323	337	324	349	368	384	365	392	414	432	403	434	458	477		
Lo PR	111	118	129	137	117	125	136	145	122	130	142	151	128	136	149	158	134	143	156	166	139	148	161	172		
MBh	21.4	22.1	23.9	25.6	20.9	21.6	23.3	25.0	20.4	21.0	22.8	24.4	19.9	20.5	22.2	23.8	18.9	19.5	21.1	22.7	17.5	18.1	19.6	21.0		
S/T	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.38	0.88	0.79	0.60	0.39	0.91	0.82	0.62	0.40	0.95	0.85	0.64	0.41	0.96	0.85	0.65	0.42		
ΔT	21	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	20	19	15	10		
kW	1.52	1.56	1.61	1.66	1.64	1.68	1.73	1.79	1.75	1.79	1.85	1.91	1.84	1.88	1.95	2.01	1.92	1.97	2.03	2.10	1.99	2.04	2.10	2.18		
Amps	5.8	6.0	6.2	6.4	6.3	6.4	6.6	6.9	6.8	7.0	7.2	7.5	7.3	7.5	7.7	8.0	7.8	8.0	8.2	8.5	8.2	8.4	8.7	9.0		
Hi PR	216	233	246	256	243	261	276	288	276	297	314	327	314	338	357	373	354	381	402	419	391	421	444	463		
Lo PR	108	115	125	133	114	121	132	141	118	126	137	146	124	132	144	154	130	139	151	161	135	143	156	167		

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (compressor + fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	24.7	25.6	28.1	-	24.1	25.0	27.4	-	23.6	24.4	26.8	-	23.0	23.8	26.1	-	21.8	22.6	24.8	-	20.2	21.0	23.0	-
	S/T	0.75	0.62	0.43	-	0.77	0.65	0.45	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.85	0.71	0.49	-	0.86	0.72	0.50	-
	ΔT	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	19	16	12	-	18	15	12	-
	kW	1.44	1.48	1.52	-	1.56	1.59	1.64	-	1.66	1.69	1.75	-	1.74	1.78	1.84	-	1.82	1.86	1.92	-	1.88	1.93	1.99	-
	Amps	5.8	5.9	6.1	-	6.2	6.3	6.5	-	6.7	6.9	7.1	-	7.2	7.3	7.6	-	7.6	7.8	8.0	-	8.0	8.2	8.5	-
	Hi PR	207	223	236	-	233	250	265	-	265	285	301	-	302	324	343	-	339	365	385	-	375	403	426	-
Lo PR	111	118	129	-	117	124	136	-	122	129	141	-	128	136	148	-	134	142	155	-	138	147	161	-	
70	MBh	24.0	24.9	27.3	-	23.4	24.3	26.6	-	22.9	23.7	26.0	-	22.3	23.1	25.4	-	21.2	22.0	24.1	-	19.6	20.4	22.3	-
	S/T	0.71	0.59	0.41	-	0.74	0.62	0.43	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.81	0.68	0.47	-	0.82	0.68	0.47	-
	ΔT	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	18	16	12	-
	kW	1.43	1.46	1.51	-	1.54	1.58	1.63	-	1.64	1.68	1.73	-	1.73	1.77	1.83	-	1.80	1.84	1.91	-	1.87	1.91	1.97	-
	Amps	5.7	5.8	6.0	-	6.2	6.3	6.5	-	6.7	6.8	7.0	-	7.1	7.3	7.5	-	7.5	7.7	8.0	-	8.0	8.1	8.4	-
	Hi PR	205	221	233	-	230	248	262	-	262	282	298	-	299	321	339	-	336	361	382	-	371	399	422	-
Lo PR	110	117	127	-	116	123	135	-	120	128	140	-	126	135	147	-	133	141	154	-	137	146	159	-	
700	MBh	22.2	23.0	25.2	-	21.6	22.4	24.6	-	21.1	21.9	24.0	-	20.6	21.4	23.4	-	19.6	20.3	22.2	-	18.1	18.8	20.6	-
	S/T	0.69	0.57	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.79	0.66	0.46	-
	ΔT	20	17	13	-	20	18	13	-	20	18	13	-	20	18	13	-	20	17	13	-	19	16	12	-
	kW	1.40	1.43	1.47	-	1.51	1.54	1.59	-	1.60	1.64	1.69	-	1.69	1.72	1.78	-	1.76	1.80	1.86	-	1.82	1.86	1.92	-
	Amps	5.6	5.7	5.9	-	6.0	6.1	6.3	-	6.5	6.6	6.8	-	6.9	7.1	7.3	-	7.3	7.5	7.7	-	7.7	7.9	8.2	-
	Hi PR	199	214	226	-	224	241	254	-	254	274	289	-	290	312	329	-	326	351	370	-	360	387	409	-
Lo PR	106	113	124	-	112	120	131	-	117	124	136	-	123	131	142	-	129	137	149	-	133	141	154	-	

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
75	MBh	25.1	25.9	28.0	30.1	24.6	25.3	27.4	29.4	24.0	24.7	26.7	28.7	23.4	24.1	26.1	28.0	22.2	22.9	24.8	26.6	20.6	21.2	22.9	24.6
	S/T	0.85	0.76	0.57	0.37	0.88	0.79	0.60	0.38	0.90	0.81	0.61	0.39	0.93	0.83	0.63	0.41	0.97	0.86	0.65	0.42	0.97	0.87	0.66	0.42
	ΔT	22	20	16	11	22	20	17	11	22	20	17	12	22	20	17	12	22	20	17	11	20	19	15	11
	kW	1.46	1.49	1.53	1.59	1.57	1.60	1.66	1.71	1.67	1.71	1.76	1.82	1.76	1.80	1.86	1.92	1.83	1.88	1.94	2.00	1.90	1.94	2.01	2.08
	Amps	5.8	5.9	6.1	6.3	6.3	6.4	6.6	6.8	6.8	6.9	7.2	7.4	7.2	7.4	7.6	7.9	7.7	7.8	8.1	8.4	8.1	8.3	8.6	8.9
	Hi PR	210	226	238	248	235	253	267	279	267	288	304	317	305	328	346	361	343	369	389	406	379	407	430	449
Lo PR	112	119	130	138	118	126	137	146	123	131	143	152	129	137	150	160	135	144	157	167	140	149	162	173	
75	MBh	24.4	25.1	27.2	29.2	23.8	24.5	26.6	28.5	23.3	24.0	25.9	27.8	22.7	23.4	25.3	27.2	21.6	22.2	24.0	25.8	20.0	20.6	22.3	23.9
	S/T	0.81	0.72	0.55	0.35	0.84	0.75	0.57	0.37	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.92	0.82	0.62	0.40	0.93	0.83	0.63	0.40
	ΔT	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	20	16	11
	kW	1.44	1.48	1.52	1.57	1.56	1.59	1.64	1.70	1.66	1.69	1.75	1.81	1.74	1.78	1.84	1.90	1.82	1.86	1.92	1.99	1.88	1.93	1.99	2.06
	Amps	5.8	5.9	6.1	6.3	6.2	6.3	6.5	6.8	6.7	6.9	7.1	7.3	7.2	7.3	7.6	7.8	7.6	7.8	8.0	8.3	8.0	8.2	8.5	8.8
	Hi PR	207	223	236	246	233	251	265	276	265	285	301	314	302	325	343	357	339	365	386	402	375	403	426	444
Lo PR	111	118	129	137	117	125	136	145	122	129	141	150	128	136	148	158	134	142	156	166	139	147	161	171	
700	MBh	22.5	23.2	25.1	26.9	22.0	22.7	24.5	26.3	21.5	22.1	23.9	25.7	21.0	21.6	23.4	25.1	19.9	20.5	22.2	23.8	18.4	19.0	20.6	22.1
	S/T	0.78	0.70	0.53	0.34	0.81	0.72	0.55	0.35	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.90	0.80	0.61	0.39
	ΔT	23	21	17	12	23	22	18	12	23	22	18	12	24	22	18	12	23	21	18	12	22	20	16	11
	kW	1.41	1.44	1.49	1.53	1.52	1.55	1.60	1.65	1.62	1.65	1.70	1.76	1.70	1.74	1.80	1.86	1.77	1.81	1.87	1.94	1.83	1.88	1.94	2.01
	Amps	5.6	5.7	5.9	6.1	6.0	6.2	6.4	6.6	6.5	6.7	6.9	7.2	7.0	7.1	7.4	7.6	7.4	7.6	7.8	8.1	7.8	8.0	8.3	8.6
	Hi PR	201	217	229	239	226	243	257	268	257	276	292	304	293	315	332	347	329	354	374	390	364	391	413	431
Lo PR	107	114	125	133	114	121	132	140	118	126	137	146	124	132	144	153	130	138	151	161	134	143	156	166	

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (compressor + fan)

IDB	65°F				75°F				85°F				95°F				105°F				115°F				
													ENTERING INDOOR WET BULB TEMPERATURE				ENTERING INDOOR DRY BULB TEMPERATURE								
	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
900	MBh	25.6	26.1	27.9	29.9	25.0	25.5	27.3	29.2	24.4	24.9	26.6	28.5	23.8	24.3	26.0	27.8	22.6	23.1	24.7	26.4	20.9	21.4	22.9	24.4
	S/T	0.93	0.87	0.71	0.53	0.96	0.90	0.74	0.55	1.00	0.93	0.75	0.56	1.00	0.96	0.78	0.58	1.00	1.00	0.81	0.60	1.00	1.00	0.82	0.61
	ΔT	24	23	20	16	25	24	21	16	25	24	21	16	24	24	21	17	23	24	20	16	21	22	19	15
	kW	1.47	1.50	1.55	1.60	1.58	1.62	1.67	1.73	1.68	1.72	1.78	1.84	1.77	1.81	1.87	1.94	1.85	1.89	1.95	2.02	1.92	1.96	2.02	2.09
	Amps	5.9	6.0	6.2	6.4	6.3	6.5	6.7	6.9	6.8	7.0	7.2	7.5	7.3	7.5	7.7	8.0	7.7	7.9	8.2	8.5	8.2	8.4	8.6	9.0
800	Hi PR	212	228	241	251	238	256	270	282	270	291	307	320	308	331	350	365	346	372	393	410	382	412	435	453
	Lo PR	113	120	131	140	119	127	139	148	124	132	144	154	130	139	151	161	137	145	159	169	141	150	164	175
	MBh	24.8	25.4	27.1	29.0	24.3	24.8	26.5	28.3	23.7	24.2	25.9	27.6	23.1	23.6	25.2	27.0	22.0	22.4	24.0	25.6	20.3	20.8	22.2	23.7
	S/T	0.89	0.83	0.68	0.51	0.92	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.56	1.00	0.95	0.77	0.58	1.00	0.96	0.78	0.58
	ΔT	25	24	21	17	26	25	21	17	26	25	21	17	26	25	22	17	25	24	21	17	23	23	20	16
700	kW	1.46	1.49	1.54	1.59	1.57	1.60	1.66	1.71	1.67	1.71	1.76	1.82	1.76	1.80	1.86	1.92	1.83	1.88	1.94	2.00	1.90	1.94	2.01	2.08
	Amps	5.8	5.9	6.1	6.3	6.3	6.4	6.6	6.8	6.8	6.9	7.2	7.4	7.2	7.4	7.6	7.9	7.7	7.8	8.1	8.4	8.1	8.3	8.6	8.9
	Hi PR	210	226	238	248	235	253	267	279	267	288	304	317	305	328	346	361	343	369	389	406	379	407	430	449
	Lo PR	112	119	130	138	118	126	137	146	123	131	143	152	129	137	150	160	135	144	157	167	140	149	162	173
	MBh	22.9	23.4	25.0	26.8	22.4	22.9	24.5	26.1	21.9	22.3	23.9	25.5	21.3	21.8	23.3	24.9	20.3	20.7	22.1	23.7	18.8	19.2	20.5	21.9
85	S/T	0.86	0.80	0.65	0.49	0.89	0.83	0.68	0.51	0.91	0.85	0.69	0.52	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.56	0.98	0.92	0.75	0.56
	ΔT	26	25	21	17	26	25	22	17	26	25	22	17	26	25	22	18	26	25	22	17	24	23	20	16
	kW	1.42	1.45	1.50	1.55	1.53	1.56	1.62	1.67	1.63	1.66	1.72	1.78	1.71	1.75	1.81	1.87	1.79	1.83	1.89	1.95	1.85	1.89	1.96	2.02
	Amps	5.7	5.8	6.0	6.2	6.1	6.2	6.4	6.7	6.6	6.8	7.0	7.2	7.0	7.2	7.4	7.7	7.5	7.6	7.9	8.2	7.9	8.1	8.3	8.6
	Hi PR	203	219	231	241	228	245	259	270	259	279	295	307	295	318	336	350	332	358	378	394	367	395	417	435
900	Lo PR	109	115	126	134	115	122	133	142	119	127	138	147	125	133	145	155	131	140	152	162	136	144	158	168
	MBh	26.0	26.5	27.8	29.7	25.4	25.9	27.2	29.0	24.8	25.3	26.5	28.3	24.2	24.7	25.9	27.6	23.0	23.5	24.6	26.2	21.3	21.7	22.8	24.3
	S/T	0.98	0.94	0.85	0.69	1.00	0.98	0.88	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.97	0.78	1.00	1.00	0.98	0.79
	ΔT	26	26	24	21	26	26	24	21	25	26	24	21	25	25	25	21	24	24	24	21	22	22	23	20
	kW	1.48	1.51	1.56	1.61	1.60	1.63	1.68	1.74	1.70	1.74	1.79	1.85	1.79	1.83	1.89	1.95	1.87	1.91	1.97	2.04	1.93	1.98	2.04	2.11
800	Amps	5.9	6.1	6.2	6.5	6.4	6.5	6.7	7.0	6.9	7.1	7.3	7.5	7.3	7.5	7.8	8.0	7.8	8.0	8.2	8.5	8.2	8.4	8.7	9.0
	Hi PR	214	230	243	253	240	258	273	284	273	294	310	323	311	334	353	368	350	376	397	414	386	416	439	458
	Lo PR	114	121	133	141	121	128	140	149	125	133	146	155	132	140	153	163	138	147	160	171	143	152	166	177
	MBh	25.3	25.8	27.0	28.8	24.7	25.2	26.4	28.1	24.1	24.6	25.7	27.5	23.5	24.0	25.1	26.8	22.3	22.8	23.8	25.4	20.7	21.1	22.1	23.6
	S/T	0.93	0.90	0.81	0.66	0.96	0.93	0.84	0.68	0.99	0.95	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.75	1.00	1.00	0.93	0.75
700	ΔT	27	27	25	22	27	27	25	22	27	27	25	22	27	27	26	22	26	26	25	22	24	24	24	20
	kW	1.47	1.50	1.55	1.60	1.58	1.62	1.67	1.73	1.68	1.72	1.78	1.84	1.77	1.81	1.87	1.94	1.85	1.89	1.95	2.02	1.92	1.96	2.02	2.09
	Amps	5.9	6.0	6.2	6.4	6.3	6.5	6.7	6.9	6.8	7.0	7.2	7.5	7.3	7.5	7.7	8.0	7.7	7.9	8.2	8.5	8.2	8.4	8.6	9.0
	Hi PR	212	228	241	251	238	256	270	282	270	291	307	320	308	331	350	365	346	372	393	410	382	412	435	453
	Lo PR	113	120	131	140	119	127	139	148	124	132	144	154	130	139	151	161	137	145	159	169	141	150	164	175

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (compressor + fan)

EXPANDED COOLING DATA — DSZC160481A* / CA*F4961*6** + TXV / MBVC2000**-1 — LOW STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																																								
		65°F						75°F						85°F						95°F						105°F						115°F										
		59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79					
80	1209	MBh	34.9	35.7	38.1	40.8	34.1	34.9	37.2	39.8	33.3	34.0	36.3	38.9	32.5	33.2	35.5	37.9	30.9	31.5	33.7	36.0	28.6	29.2	31.2	33.4	30.9	31.5	33.7	36.0	31.5	33.7	36.0	30.9	31.5	33.7	36.0	28.6	29.2	31.2	33.4	
		S/T	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	1.00	0.92	0.75	0.56	1.00	0.95	0.78	0.58	1.00	1.00	1.00	0.80	0.60	1.00	1.00	0.81	0.61	1.00	1.00	0.80	0.60	1.00	1.00	0.80	1.00	1.00	0.80	0.60	1.00	1.00	0.81	0.61
		ΔT	25	24	20	16	25	24	21	17	25	24	21	17	25	24	21	17	25	23	24	21	16	22	22	19	15	23	24	21	16	25	25	21	23	24	21	16	22	22	19	15
	kW	1.99	2.04	2.10	2.17	2.15	2.20	2.27	2.35	2.29	2.34	2.42	2.50	2.42	2.47	2.55	2.64	2.52	2.52	2.58	2.67	2.76	2.61	2.67	2.76	2.86	2.52	2.58	2.67	2.76	2.52	2.58	2.67	2.76	2.52	2.58	2.67	2.76	2.61	2.67	2.76	2.86
	Amps	7.7	7.9	8.2	8.5	8.4	8.6	8.8	9.2	9.1	9.3	9.6	10.0	9.7	9.9	10.3	10.6	10.3	10.3	10.6	10.9	11.3	10.9	11.2	11.6	12.0	10.3	10.6	10.9	11.3	10.3	10.6	10.9	11.3	10.3	10.6	10.9	11.3	10.9	11.2	11.6	12.0
	Hi PR	209	225	237	247	234	252	266	278	266	287	303	316	303	327	345	360	341	367	388	405	377	406	429	447	341	367	388	405	341	367	388	405	341	367	388	405	377	406	429	447	
	Lo PR	111	118	129	137	117	125	136	145	122	130	142	151	128	136	149	158	134	143	156	166	139	148	161	172	134	143	156	166	134	143	156	166	134	143	156	166	139	148	161	172	
	MBh	33.9	34.6	37.0	39.6	33.1	33.8	36.2	38.6	32.3	33.0	35.3	37.7	31.5	32.2	34.4	36.8	30.0	30.6	32.7	35.0	27.8	28.4	30.3	32.4	30.0	30.6	32.7	35.0	30.0	30.6	32.7	35.0	30.0	30.6	32.7	35.0	27.8	28.4	30.3	32.4	
	S/T	0.88	0.83	0.67	0.50	0.91	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.55	1.00	0.94	0.77	0.57	1.00	0.95	0.77	0.58	1.00	0.94	0.77	0.57	1.00	0.94	0.77	0.57	1.00	0.95	0.77	0.58					
	ΔT	26	25	21	17	26	25	22	17	26	25	22	17	26	25	22	17	26	26	25	21	17	24	23	20	16	26	25	21	17	26	25	21	17	24	23	20	16				
	kW	1.98	2.02	2.09	2.16	2.13	2.18	2.25	2.33	2.27	2.32	2.40	2.48	2.40	2.45	2.53	2.62	2.50	2.56	2.64	2.73	2.59	2.65	2.74	2.83	2.50	2.56	2.64	2.73	2.50	2.56	2.64	2.73	2.59	2.65	2.74	2.83					
	Amps	7.7	7.9	8.1	8.4	8.3	8.5	8.8	9.1	9.0	9.2	9.5	9.9	9.6	9.8	10.2	10.5	10.2	10.5	10.8	11.2	10.8	11.1	11.4	11.9	10.2	10.5	10.8	11.2	10.2	10.5	10.8	11.2	10.8	11.1	11.4	11.9					
Hi PR	207	222	235	245	232	250	264	275	264	284	300	313	300	323	341	356	338	364	384	401	373	402	424	443	338	364	384	401	338	364	384	401	373	402	424	443						
Lo PR	110	117	128	136	116	124	135	144	121	128	140	149	127	135	147	157	133	141	154	164	137	146	160	170	133	141	154	164	133	141	154	164	137	146	160	170						
MBh	31.3	32.0	34.2	36.5	30.6	31.2	33.4	35.7	29.8	30.5	32.6	34.8	29.1	29.7	31.8	34.0	27.7	28.3	30.2	32.3	25.6	26.2	28.0	29.9	27.7	28.3	30.2	32.3	27.7	28.3	30.2	32.3	25.6	26.2	28.0	29.9						
S/T	0.85	0.80	0.65	0.49	0.88	0.83	0.67	0.50	0.90	0.85	0.69	0.52	0.93	0.88	0.71	0.53	0.97	0.91	0.74	0.55	0.98	0.92	0.75	0.56	0.97	0.91	0.74	0.55	0.97	0.91	0.74	0.55	0.98	0.92	0.75	0.56						
ΔT	26	25	22	17	26	25	22	18	26	25	22	18	27	25	22	18	26	26	25	22	17	24	23	20	16	26	25	22	17	26	25	22	17	24	23	20	16					
kW	1.93	1.97	2.03	2.10	2.08	2.13	2.20	2.27	2.22	2.26	2.34	2.42	2.33	2.39	2.47	2.55	2.43	2.49	2.57	2.66	2.52	2.58	2.67	2.76	2.43	2.49	2.57	2.66	2.43	2.49	2.57	2.66	2.52	2.58	2.67	2.76						
Amps	7.5	7.6	7.9	8.2	8.1	8.3	8.5	8.8	8.8	9.0	9.3	9.6	9.3	9.6	9.9	10.3	9.9	10.2	10.5	10.9	10.5	10.8	11.1	11.6	10.3	10.6	10.9	11.3	9.9	10.2	10.5	10.9	10.5	10.8	11.1	11.6						
Hi PR	201	216	228	238	225	242	256	267	256	275	291	303	291	314	331	345	328	353	373	389	362	390	412	429	328	353	373	389	328	353	373	389	362	390	412	429						
Lo PR	107	113	124	132	113	120	131	139	117	125	136	145	123	131	143	152	129	137	150	159	133	142	155	165	129	137	150	159	129	137	150	159	133	142	155	165						

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHR1 (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (compressor + fan)

	OUTDOOR AMBIENT TEMPERATURE																																																			
	65°F					75°F					85°F					95°F					105°F					115°F																										
	IDB	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71																						
ENTERING INDOOR WET BULB TEMPERATURE																																																				
70	MBh	46.5	48.2	52.9	45.5	47.1	51.6	44.4	46.0	50.4	43.3	44.9	49.2	41.1	42.6	46.7	41.1	42.6	46.7	38.1	39.5	43.3	38.1	39.5	43.3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-											
	S/T	0.76	0.63	0.44	0.79	0.66	0.45	0.81	0.67	0.47	0.83	0.70	0.48	0.86	0.72	0.50	0.86	0.72	0.50	0.87	0.73	0.50	0.87	0.73	0.50	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-									
	ΔT	19	16	12	19	16	12	19	16	12	19	16	12	19	16	12	19	16	12	18	15	11	18	15	11	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-						
	kW	2.82	2.88	2.98	3.04	3.11	3.21	3.24	3.31	3.42	3.41	3.48	3.60	3.55	3.63	3.75	3.55	3.63	3.75	3.68	3.76	3.89	3.68	3.76	3.89	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-						
	Amps	5.8	6.0	6.4	6.6	6.9	7.3	7.6	7.9	8.3	8.5	8.8	9.3	9.3	9.7	10.2	9.3	9.7	10.2	10.2	10.5	11.1	10.2	10.5	11.1	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-					
	Hi PR	212	228	241	238	256	270	270	291	307	308	331	350	346	373	393	346	373	393	382	412	435	382	412	435	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	Lo PR	107	114	124	113	120	131	117	125	136	123	131	143	129	137	150	123	131	143	133	142	155	133	142	155	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-			
	MBh	45.2	46.8	51.3	44.1	45.7	50.1	43.1	44.7	48.9	42.0	43.6	47.7	39.9	41.4	45.4	39.9	41.4	45.4	37.0	38.3	42.0	37.0	38.3	42.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-			
	S/T	0.72	0.60	0.42	0.75	0.63	0.43	0.77	0.64	0.44	0.79	0.66	0.46	0.82	0.69	0.48	0.82	0.69	0.48	0.83	0.69	0.48	0.83	0.69	0.48	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
	ΔT	19	17	13	20	17	13	20	17	13	20	17	13	20	17	13	20	17	13	18	16	12	18	16	12	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	kW	2.80	2.86	2.95	3.02	3.08	3.18	3.21	3.28	3.39	3.21	3.28	3.39	3.38	3.45	3.57	3.38	3.45	3.57	3.52	3.60	3.72	3.52	3.60	3.72	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	Amps	5.7	5.9	6.3	6.5	6.8	7.2	7.5	7.8	8.2	8.4	8.7	9.1	9.2	9.5	10.0	9.2	9.5	10.0	10.0	10.4	10.9	10.0	10.4	10.9	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Hi PR	210	226	238	235	253	267	267	288	304	267	288	304	305	328	346	305	328	346	343	369	389	343	369	389	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Lo PR	106	112	123	112	119	130	116	123	135	116	123	135	122	130	142	122	130	142	128	136	148	128	136	148	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
MBh	41.7	43.2	47.4	40.7	42.2	46.3	39.8	41.2	45.2	38.8	40.2	44.1	36.9	38.2	41.9	36.9	38.2	41.9	34.1	35.4	38.8	34.1	35.4	38.8	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
S/T	0.70	0.58	0.40	0.72	0.60	0.42	0.74	0.62	0.43	0.77	0.64	0.44	0.80	0.66	0.46	0.79	0.66	0.46	0.80	0.67	0.46	0.80	0.67	0.46	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
ΔT	20	17	13	20	17	13	20	17	13	20	17	13	20	17	13	20	17	13	19	16	12	19	16	12	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
kW	2.73	2.79	2.88	2.94	3.01	3.10	3.13	3.20	3.30	3.13	3.20	3.30	3.29	3.37	3.48	3.29	3.37	3.48	3.43	3.51	3.63	3.43	3.51	3.63	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Amps	5.4	5.6	6.0	6.2	6.5	6.9	7.2	7.5	7.9	8.0	8.3	8.7	8.8	9.1	9.6	8.8	9.1	9.6	9.6	10.0	10.5	9.6	10.0	10.5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Hi PR	203	219	231	228	245	259	259	279	295	259	279	295	296	318	336	296	318	336	332	358	378	332	358	378	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Lo PR	102	109	119	108	115	126	113	120	131	113	120	131	118	126	137	118	126	137	124	132	144	124	132	144	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (compressor + fan)

		OUTDOOR AMBIENT TEMPERATURE																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																							
		65°F						75°F						85°F							95°F						105°F						115°F																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																								
		59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79		59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																			
IDB	AIRFLOW	40.8	41.7	44.5	47.6	39.8	40.7	43.5	46.5	38.9	39.7	42.5	45.4	37.9	38.8	41.4	44.3	36.0	36.8	39.3	42.1	33.4	34.1	36.4	39.0	0.90	0.85	0.69	0.51	0.93	0.88	0.71	0.53	0.96	0.90	0.73	0.55	1.00	0.93	0.75	0.56	1.00	0.96	0.78	0.59	1.00	0.97	0.79	0.59	2.42	2.47	2.55	2.63	2.61	2.67	2.75	2.84	2.77	2.84	2.93	3.03	2.92	2.99	3.09	3.19	3.05	3.12	3.22	3.33	3.15	3.23	3.34	3.45	209	225	238	248	235	253	267	278	267	287	303	316	304	327	345	360	342	368	389	405	378	407	429	448	109	116	126	134	115	122	133	142	119	127	139	148	125	133	146	155	131	140	153	163	136	145	158	168	39.6	40.5	43.2	46.2	38.7	39.5	42.2	45.1	37.8	38.6	41.2	44.1	36.8	37.6	40.2	43.0	35.0	35.8	38.2	40.8	32.4	33.1	35.4	37.8	0.86	0.81	0.66	0.49	0.89	0.84	0.68	0.51	0.91	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.98	0.92	0.75	0.56	0.99	0.93	0.75	0.56	2.40	2.45	2.53	2.61	2.59	2.64	2.73	2.82	2.75	2.81	2.91	3.00	2.90	2.96	3.06	3.16	3.02	3.09	3.19	3.30	3.13	3.20	3.31	3.42	207	223	235	245	232	250	264	275	264	284	300	313	301	324	342	357	339	364	385	401	374	403	425	443	108	114	125	133	114	121	132	141	118	126	137	146	124	132	144	154	130	138	151	161	135	143	156	166	39.0	39.9	42.6	45.5	38.1	38.9	41.6	44.5	37.2	38.0	40.6	43.4	36.3	37.1	39.6	42.3	34.5	35.2	37.6	40.2	31.9	32.6	34.9	37.3	0.83	0.78	0.63	0.47	0.86	0.81	0.66	0.49	0.88	0.83	0.67	0.50	0.91	0.85	0.69	0.52	0.94	0.89	0.72	0.54	0.95	0.89	0.73	0.54	2.37	2.42	2.49	2.58	2.55	2.61	2.69	2.78	2.71	2.77	2.86	2.96	2.86	2.92	3.02	3.12	2.98	3.05	3.15	3.25	3.08	3.15	3.26	3.37	204	219	231	241	228	246	260	271	260	280	295	308	296	318	336	351	333	358	378	394	368	396	418	436	106	113	123	131	112	119	130	138	116	124	135	144	122	130	142	151	128	136	149	158	132	141	154	164	41.5	42.3	44.3	47.3	40.5	41.3	43.3	46.2	39.6	40.3	42.2	45.1	38.6	39.3	41.2	44.0	36.7	37.4	39.1	41.8	34.0	34.6	36.3	38.7	0.95	0.91	0.82	0.67	0.98	0.95	0.85	0.69	1.00	0.97	0.87	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.94	0.76	1.00	1.00	0.94	0.77	2.44	2.49	2.57	2.66	2.63	2.69	2.77	2.87	2.80	2.86	2.95	3.05	2.95	3.01	3.11	3.22	3.07	3.14	3.25	3.36	3.18	3.25	3.36	3.48	9.1	9.3	9.6	9.9	9.8	10.0	10.3	10.7	10.6	10.8	11.2	11.6	11.3	11.5	11.9	12.3	12.0	12.2	12.6	13.1	12.6	12.9	13.4	13.8	211	227	240	250	237	255	269	281	270	290	306	319	307	330	349	364	345	372	392	409	382	411	434	452	110	117	127	136	116	123	135	143	121	128	140	149	127	135	147	157	133	141	154	164	137	146	159	170	40.3	41.1	43.0	45.9	39.3	40.1	42.0	44.8	38.4	39.2	41.0	43.8	37.5	38.2	40.0	42.7	35.6	36.3	38.0	40.5	33.0	33.6	35.2	37.6	0.90	0.87	0.79	0.64	0.93	0.90	0.81	0.66	0.96	0.92	0.83	0.68	0.99	0.95	0.86	0.70	1.00	0.99	0.89	0.73	1.00	1.00	0.90	0.73	2.42	2.47	2.55	2.63	2.61	2.67	2.75	2.84	2.77	2.84	2.93	3.03	2.92	2.99	3.09	3.19	3.05	3.12	3.22	3.33	3.15	3.23	3.34	3.45	9.0	9.2	9.5	9.9	9.7	9.9	10.2	10.6	10.5	10.7	11.1	11.5	11.2	11.4	11.8	12.2	11.9	12.1	12.5	13.0	12.5	12.8	13.2	13.7	209	225	238	248	235	253	267	278	267	287	303	316	304	327	345	360	342	368	389	405	378	407	429	448	109	116	126	134	115	122	133	142	119	127	139	148	125	133	146	155	131	140	153	163	136	145	158	168	39.7	40.5	42.4	45.2	38.8	39.5	41.4	44.1	37.8	38.6	40.4	43.1	36.9	37.6	39.4	42.0	35.1	35.7	37.4	39.9	32.5	33.1	34.7	37.0	0.87	0.84	0.76	0.61	0.90	0.87	0.78	0.64	0.92	0.89	0.80	0.65	0.95	0.92	0.83	0.67	0.99	0.96	0.86	0.70	1.00	0.96	0.87	0.71	2.39	2.44	2.52	2.60	2.57	2.63	2.71	2.80	2.74	2.80	2.89	2.98	2.88	2.94	3.04	3.15	3.00	3.07	3.17	3.28	3.11	3.18	3.29	3.40	8.9	9.1	9.4	9.7	9.6	9.8	10.1	10.5	10.4	10.6	10.9	11.3	11.0	11.3	11.6	12.0	11.7	12.0	12.3	12.8	12.3	12.6	13.0	13.5	206	221	234	244	231	248	262	273	262	282	298	311	299	322	340	354	336	362	382	398	371	400	422	440	107	114	124	132	113	120	131	140	117	125	136	145	123	131	143	152	129	137	150	160	134	142	155	165

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (compressor + fan)

DSZC160241A* / CA*F3636*6A* + TXV / MBE1600**-1 — LOW STAGE

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	20.8	19.7	18.5	17.3	16.6	16.0	14.9	13.7	13.1	12.1	11.1	10.5	10.1	9.1	8.1	7.0	6.0	4.9
ΔT	30.2	28.6	26.9	25.2	24.1	23.3	21.7	20.0	19.0	17.6	16.2	15.3	14.7	13.2	11.7	10.2	8.7	7.1
kW	1.42	1.40	1.37	1.34	1.3	1.31	1.28	1.25	1.37	1.33	1.30	1.28	1.27	1.23	1.20	1.17	1.14	1.10
Amps	6.8	6.3	5.9	5.6	5.4	5.3	5.0	4.7	4.5	4.3	4.1	4.0	4.0	3.8	3.5	3.3	3.1	2.8
COP	4.27	4.13	3.97	3.79	3.67	3.59	3.41	3.21	2.81	2.66	2.51	2.40	2.34	2.15	1.96	1.76	1.54	1.30
EER	14.6	14.1	13.6	13.0	12.5	12.3	11.6	11.0	9.6	9.1	8.6	8.2	8.0	7.4	6.7	6.0	5.3	4.5

DSZC160241A* / CA*F3636*6A* + TXV / MBE1600**-1 — HIGH STAGE

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	30.2	28.6	26.9	25.1	24.0	23.3	21.6	19.9	18.7	17.3	15.9	15.0	14.4	13.0	11.5	10.0	8.6	7.0
ΔT	31.9	30.2	28.4	26.6	25.4	24.6	22.9	21.1	19.8	18.3	16.8	15.9	15.3	13.7	12.2	10.6	9.0	7.4
kW	1.86	1.83	1.79	1.75	1.7	1.71	1.68	1.64	1.72	1.68	1.64	1.61	1.60	1.56	1.52	1.48	1.44	1.40
Amps	8.7	8.0	7.5	7.1	6.8	6.7	6.3	6.0	5.7	5.5	5.2	5.1	5.0	4.8	4.5	4.2	3.9	3.5
COP	4.74	4.58	4.40	4.20	4.06	3.97	3.77	3.55	3.18	3.01	2.84	2.72	2.65	2.44	2.22	1.99	1.74	1.47
EER	16.2	15.6	15.0	14.3	13.9	13.6	12.9	12.1	10.9	10.3	9.7	9.3	9.0	8.3	7.6	6.8	6.0	5.0

DSZC160361A* / CA*F3642*6A* + TXV / MBE1600**-1 — LOW STAGE

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	30.3	28.7	27.0	25.3	24.1	23.4	21.7	20.0	18.1	16.7	15.4	14.5	14.0	12.6	11.1	9.7	8.3	6.8
ΔT	35.1	33.2	31.3	29.2	27.9	27.1	25.1	23.2	21.0	19.4	17.8	16.8	16.2	14.5	12.9	11.2	9.6	7.9
kW	2.03	1.98	1.94	1.90	1.9	1.86	1.82	1.78	1.93	1.89	1.84	1.81	1.79	1.75	1.70	1.65	1.61	1.56
Amps	9.8	9.1	8.5	8.0	7.8	7.6	7.2	6.8	6.6	6.3	6.0	5.8	5.8	5.5	5.1	4.8	4.5	4.1
COP	4.38	4.23	4.07	3.89	3.76	3.68	3.49	3.29	2.74	2.60	2.45	2.35	2.29	2.11	1.92	1.72	1.51	1.27
EER	15.0	14.5	13.9	13.3	12.8	12.6	11.9	11.3	9.4	8.9	8.4	8.0	7.8	7.2	6.6	5.9	5.2	4.4

DSZC160361A* / CA*F3642*6A* + TXV / MBE1600**-1 — HIGH STAGE

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	43.2	40.9	38.5	36.0	34.4	33.3	31.0	28.6	26.2	24.2	22.2	21.0	20.2	18.1	16.1	14.0	12.0	9.8
ΔT	34.8	33.0	31.0	29.0	27.7	26.8	24.9	23.0	21.1	19.4	17.9	16.9	16.3	14.6	13.0	11.3	9.6	7.9
kW	2.80	2.74	2.69	2.63	2.6	2.57	2.52	2.46	2.39	2.33	2.28	2.24	2.22	2.16	2.11	2.05	2.00	1.94
Amps	13.1	12.1	11.4	10.7	10.3	10.1	9.5	9.1	8.7	8.3	7.9	7.7	7.6	7.2	6.7	6.4	5.9	5.3
COP	4.52	4.37	4.20	4.01	3.88	3.79	3.60	3.40	3.21	3.03	2.86	2.74	2.66	2.45	2.23	2.00	1.75	1.48
EER	15.4	14.9	14.3	13.7	13.2	13.0	12.3	11.6	11.0	10.4	9.8	9.4	9.1	8.4	7.6	6.8	6.0	5.0

Calculations are based on nominal CFM and 70 °F indoor dry bulb.

Note: Shaded area is AHRI Rating Conditions at 47°F outdoor ambient temperature

Amps = Outdoor unit amps (comp.+fan)

kW = Total system power

DSZC160481A* / CA*F4860*6A* +T XV / MBE2000-1 — LOW STAGE**

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	43.2	40.9	38.5	36.0	34.4	33.3	30.9	28.5	25.7	23.7	21.8	20.6	19.9	17.8	15.8	13.8	11.8	9.6
ΔT	37.2	35.2	33.1	31.0	29.6	28.7	26.6	24.6	22.1	20.4	18.8	17.8	17.1	15.4	13.6	11.9	10.1	8.3
kW	2.97	2.91	2.85	2.79	2.8	2.72	2.66	2.60	2.71	2.65	2.58	2.54	2.52	2.45	2.38	2.32	2.25	2.18
Amps	14.1	13.1	12.2	11.5	11.1	10.9	10.3	9.7	9.3	8.9	8.5	8.3	8.1	7.7	7.2	6.8	6.3	5.6
COP	4.25	4.11	3.95	3.78	3.66	3.58	3.40	3.21	2.77	2.62	2.48	2.38	2.31	2.13	1.94	1.74	1.53	1.29
EER	14.5	14.0	13.5	12.9	12.5	12.2	11.6	11.0	9.5	9.0	8.5	8.1	7.9	7.3	6.6	5.9	5.2	4.4

DSZC160481A* / CA*F4860*6A* + TXV / MBE2000-1 — HIGH STAGE**

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	59.1	55.9	52.6	49.2	47.0	45.5	42.3	39.0	41.1	38.0	34.9	33.0	31.8	28.5	25.3	22.0	18.8	15.4
ΔT	35.3	33.4	31.4	29.4	28.1	27.2	25.3	23.3	24.6	22.7	20.9	19.7	19.0	17.0	15.1	13.2	11.2	9.2
kW	3.81	3.73	3.65	3.58	3.5	3.50	3.42	3.35	3.33	3.25	3.17	3.13	3.10	3.02	2.94	2.86	2.78	2.71
Amps	18.8	17.1	15.6	14.4	13.7	13.3	12.2	11.3	10.6	9.9	9.2	8.8	8.6	7.9	7.0	6.3	5.4	4.3
COP	4.54	4.39	4.22	4.03	3.89	3.81	3.61	3.41	3.61	3.42	3.22	3.09	3.00	2.77	2.52	2.25	1.98	1.67
EER	15.5	15.0	14.4	13.8	13.3	13.0	12.4	11.7	12.3	11.7	11.0	10.6	10.3	9.5	8.6	7.7	6.8	5.7

DSZC16060B / CAPF4961D6 / MBVC2000A — LOW STAGE

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	49.9	47.3	44.5	41.6	39.7	38.5	35.8	33.0	30.8	28.4	26.2	24.7	23.8	21.3	18.9	16.5	14.1	11.5
ΔT	40.2	38.1	35.8	33.5	32.0	31.0	28.8	26.5	24.8	22.9	21.1	19.9	19.2	17.2	15.2	13.3	11.3	9.3
kW	3.51	3.44	3.36	3.29	3.3	3.22	3.15	3.08	3.47	3.38	3.30	3.25	3.22	3.13	3.05	2.96	2.88	2.79
Amps	18.3	16.9	15.9	14.9	14.4	14.1	13.3	12.7	12.1	11.6	11.1	10.8	10.7	10.1	9.5	8.9	8.3	7.5
COP	4.17	4.03	3.87	3.70	3.58	3.50	3.32	3.14	2.60	2.46	2.32	2.22	2.16	2.00	1.82	1.63	1.43	1.21
EER	14.2	13.8	13.2	12.6	12.2	12.0	11.4	10.7	8.9	8.4	7.9	7.6	7.4	6.8	6.2	5.6	4.9	4.1

DSZC16060B / CAPF4961D6 / MBVC2000A — HIGH STAGE

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	71.0	67.2	63.3	59.2	56.5	54.7	50.9	46.9	44.6	41.2	37.9	35.8	34.5	30.9	27.4	23.9	20.4	16.7
ΔT	37.6	35.6	33.5	31.3	29.9	29.0	26.9	24.8	23.6	21.8	20.1	18.9	18.2	16.4	14.5	12.7	10.8	8.8
kW	4.67	4.58	4.49	4.40	4.3	4.30	4.22	4.12	4.62	4.51	4.41	4.34	4.30	4.19	4.08	3.98	3.87	3.76
Amps	22.9	21.2	19.9	18.7	18.0	17.7	16.6	15.8	15.1	14.4	13.7	13.4	13.2	12.6	11.7	11.0	10.2	9.2
COP	4.45	4.30	4.13	3.94	3.81	3.72	3.53	3.33	2.82	2.67	2.52	2.41	2.35	2.16	1.97	1.76	1.54	1.30
EER	15.2	14.7	14.1	13.5	13.0	12.7	12.1	11.4	9.6	9.1	8.6	8.2	8.0	7.4	6.7	6.0	5.3	4.4

Calculations are based on nominal CFM and 70 °F indoor dry bulb.

Note: Shaded area is AHRI Rating Conditions at 47°F outdoor ambient temperature

Amps = Outdoor unit amps (comp.+fan)

kW = Total system power



ENERGY STAR-CERTIFIED COMBINATIONS [^]

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS [°]				TVA RATINGS ³		HEATING RATINGS [^]			CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL	SENS.	SEER ¹	EER ²	TOTAL	SENS.	Hi ⁴	HSPF ⁵	Low ⁶		
DSZC16 0241A*	CA*F3636*6D*+MBVC1600**-1A*+TXV		24,000	19,000	16.0	12.5	23,200	18,600	23,000	9.5	15,000	875	4392819
DSZC16 0361A*	CA*F3743*6D*+MBVC1600**-1A*+TXV		34,600	26,200	16.0	12.5	33,400	25,800	34,400	9.7	21,000	1,200	4415183
DSZC16 0481A*	CA*F4961*6D*+MBVC2000**-1A*+TXV		47,500	36,800	16.0	13.0	45,800	36,000	47,000	9.7	30,400	1,550	4431871
DSZC16 0601B*	CA*F4961*6D*+MBVC2000**-1A*+TXV		57,000	42,000	16.0	12.5	55,000	41,200	56,500	9.1	34,600	1,830	4514554

[^] Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps must be matched with appropriate coil components to meet ENERGY STAR® criteria. Ask your contractor for details or visit www.energystar.gov. The www.energystar.gov website provides up-to-date system combinations certified to meet ENERGY STAR requirements.

[°] Rated in accordance with ANSI/AHRI Standard 210/240

¹ Seasonal Energy Efficiency Ratio

³ TVA Rating: BTU/h @ 75°F/ 63°F - 95°F

⁵ HSPF = Heating Seasonal Performance Factor

⁷ CFM at High stage

² Energy Efficiency Ratio @ 80°F/ 67°F/ 95°F

⁴ Rated heating capacity at 47°F outdoor per AHRI 210/240

⁶ Heating capacity at 17°F outdoor

⁸ CFM at Intermediate and low stage

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- When matching outdoor unit to indoor unit, use the piston supplied with the outdoor unit or that specified on the piston kit chart supplied with the indoor unit.
- EEP - Order from Service Dept. Part No. B13707-38 or new Solid State Board B13707-35S. Part No. B13707-38 is not interchangeable with B13707-35S. The Goodman brand gas furnace contains the EEP cooling time delay.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS ^				TVA RATINGS ^3		HEATING RATINGS ^			CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL	SENS.	SEER ¹	EER ²	TOTAL	SENS.	Hi ⁴	HSPF ⁵	Low ⁶		
DSZC16 0241A* (Contd.)	CA*F3642*6D*+TXV	A*VC960603BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	800	7360686
	CA*F3642*6D*+TXV	A*VC960803BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	800	7360689
	CA*F3642*6D*+TXV	A*VM970603BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	800	7360712
	CA*F3642*6D*+TXV	A*VM970803BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	800	7360715
	CA*F3642*6D*+TXV	G*EC960302BNA*	23,600	18,800	15.5	12.0	22,800	18,400	23,600	9.0	15,000	800	7368122
	CA*F3642*6D*+TXV	G*EC960402BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	850	7368127
	CA*F3642*6D*+TXV	G*EC960603BNA*	23,600	18,800	15.5	12.0	22,800	18,400	23,600	9.0	15,000	800	7368132
	CA*F3642*6D*+TXV	G*EC960803BNA*	23,600	18,800	15.5	12.0	22,800	18,400	23,600	9.0	15,000	800	7368137
	CA*F3642*6D*+TXV	A*EC960302BNA*	23,600	18,800	15.5	12.0	22,800	18,400	23,600	9.0	15,000	800	7368157
	CA*F3642*6D*+TXV	A*EC960402BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	850	7368162
	CA*F3642*6D*+TXV	A*EC960603BNA*	23,600	18,800	15.5	12.0	22,800	18,400	23,600	9.0	15,000	800	7368167
	CA*F3642*6D*+TXV	A*EC960803BNA*	23,600	18,800	15.5	12.0	22,800	18,400	23,600	9.0	15,000	800	7368172
	CA*F3642*6D*+TXV	G*VC80803B*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	8.5	15,000	850	9924161
	CA*F3642*6D*+TXV	G*VC80804C*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	8.5	15,000	800	9924164
	CA*F3642*6D*+TXV	G*VC80805D*B*	23,800	19,000	16.0	12.0	23,000	18,600	24,000	8.5	15,000	750	9924167
	CA*F3743*6D*+TXV	G*EC960403BNA*	23,000	17,800	15.0	12.0	22,200	17,900	23,200	8.5	14,000	800	10338355
	CA*F3743*6D*+TXV	G*EC960302BNA*	23,800	19,000	15.5	12.5	23,000	18,600	23,800	9.0	15,000	800	7368123
	CA*F3743*6D*+TXV	G*EC960402BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	850	7368128
	CA*F3743*6D*+TXV	G*EC960603BNA*	23,800	19,000	15.5	12.5	23,000	18,600	23,800	9.0	15,000	800	7368133
	CA*F3743*6D*+TXV	G*EC960803BNA*	23,800	19,000	15.5	12.5	23,000	18,600	23,800	9.0	15,000	800	7368138
	CA*F3743*6D*+TXV	A*EC960302BNA*	23,800	19,000	15.5	12.5	23,000	18,600	23,800	9.0	15,000	800	7368158
	CA*F3743*6D*+TXV	A*EC960402BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	850	7368163
	CA*F3743*6D*+TXV	A*EC960603BNA*	23,800	19,000	15.5	12.5	23,000	18,600	23,800	9.0	15,000	800	7368168
	CA*F3743*6D*+TXV	A*EC960803BNA*	23,800	19,000	15.5	12.5	23,000	18,600	23,800	9.0	15,000	800	7368173
	CHPF3636B6C*+MBVC1200** -1A*+TXV		24,000	19,000	16.0	12.5	23,200	18,600	23,000	9.2	15,000	850	3654487
	CHPF3636B6C*+TXV	G*EC960403BNA*	23,000	17,800	15.0	12.0	22,200	17,900	23,200	8.5	14,000	725	10338356
	CHPF3636B6C*+TXV	G*VC80604B*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	9.0	15,000	820	5038709
	CHPF3636B6C*+TXV	A*VC80604B*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	9.0	15,000	820	5038798
	CHPF3636B6C*+TXV	G*EC960302BNA*	23,000	18,200	15.0	11.5	22,200	17,800	23,000	9.0	13,000	800	7368124
	CHPF3636B6C*+TXV	G*EC960402BNA*	23,000	18,200	15.0	11.5	22,200	17,800	23,000	9.0	13,000	850	7368129
	CHPF3636B6C*+TXV	G*EC960603BNA*	23,000	18,200	15.0	11.5	22,200	17,800	23,000	9.0	13,000	800	7368134
	CHPF3636B6C*+TXV	G*EC960803BNA*	23,000	18,200	15.0	11.5	22,200	17,800	23,000	9.0	13,000	800	7368139
	CHPF3636B6C*+TXV	A*EC960302BNA*	23,000	18,200	15.0	11.5	22,200	17,800	23,000	9.0	13,000	800	7368159
	CHPF3636B6C*+TXV	A*EC960402BNA*	23,000	18,200	15.0	11.5	22,200	17,800	23,000	9.0	13,000	850	7368164
	CHPF3636B6C*+TXV	A*EC960603BNA*	23,000	18,200	15.0	11.5	22,200	17,800	23,000	9.0	13,000	800	7368169
	CHPF3636B6C*+TXV	A*EC960803BNA*	23,000	18,200	15.0	11.5	22,200	17,800	23,000	9.0	13,000	800	7368174
	CHPF3642C6C*+MBVC1600** -1A*+TXV		24,000	19,000	16.0	12.5	23,200	18,600	24,000	9.2	15,000	860	3654501
	CHPF3642C6C*+TXV	G*EC960403BNA*	23,000	17,800	15.0	12.0	22,200	17,900	23,200	8.5	14,000	800	10338357
	CHPF3642C6C*+TXV	G*VC80805C*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	9.0	15,000	810	5038603
	CHPF3642C6C*+TXV	G*VC80604B*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	9.0	15,000	820	5038623
	CHPF3642C6C*+TXV	G*VC81005C*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	9.0	15,000	810	5038695
	CHPF3642C6C*+TXV	A*VC80805C*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	9.0	15,000	810	5038724
	CHPF3642C6C*+TXV	A*VC80604B*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	9.0	15,000	820	5038735
	CHPF3642C6C*+TXV	A*VC81005C*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	9.0	15,000	810	5038790
	CHPF3642C6C*+TXV	G*VC960403BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	800	7360632
	CHPF3642C6C*+TXV	G*VC960603BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	800	7360635
	CHPF3642C6C*+TXV	G*VC960803BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	800	7360638
	CHPF3642C6C*+TXV	G*VM970603BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	800	7360661
CHPF3642C6C*+TXV	G*VM970803BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	800	7360664	
CHPF3642C6C*+TXV	A*VC960403BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	800	7360684	
CHPF3642C6C*+TXV	A*VC960603BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	800	7360687	
CHPF3642C6C*+TXV	A*VC960803BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	800	7360690	

See Notes on Page 29.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS ^				TVA RATINGS ^3		HEATING RATINGS ^			CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL	SENS.	SEER ^1	EER ^2	TOTAL	SENS.	Hi ^4	HSPF ^5	Low ^6		
DSZC16 0241A* (Contd.)	CHPF3642C6C*+TXV	A*VM970603BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	800	7360713
	CHPF3642C6C*+TXV	A*VM970803BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	800	7360716
	CHPF3642C6C*+TXV	G*EC960302BNA*	23,800	19,000	15.5	12.5	23,000	18,600	23,800	9.0	15,000	800	7368125
	CHPF3642C6C*+TXV	G*EC960402BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	850	7368130
	CHPF3642C6C*+TXV	G*EC960603BNA*	23,800	19,000	15.5	12.5	23,000	18,600	23,800	9.0	15,000	800	7368135
	CHPF3642C6C*+TXV	G*EC960803BNA*	23,800	19,000	15.5	12.5	23,000	18,600	23,800	9.0	15,000	800	7368140
	CHPF3642C6C*+TXV	A*EC960302BNA*	23,800	19,000	15.5	12.5	23,000	18,600	23,800	9.0	15,000	800	7368160
	CHPF3642C6C*+TXV	A*EC960402BNA*	24,000	19,000	15.5	12.0	23,200	18,600	24,000	9.0	15,000	850	7368165
	CHPF3642C6C*+TXV	A*EC960603BNA*	23,800	19,000	15.5	12.5	23,000	18,600	23,800	9.0	15,000	800	7368170
	CHPF3642C6C*+TXV	A*EC960803BNA*	23,800	19,000	15.5	12.5	23,000	18,600	23,800	9.0	15,000	800	7368175
	CHPF3642C6C*+TXV	G*VC80603B*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	8.5	15,000	900	9924159
	CHPF3642C6C*+TXV	G*VC80803B*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	8.5	15,000	750	9924162
	CHPF3642C6C*+TXV	G*VC80804C*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	8.5	15,000	800	9924165
	CHPF3642C6C*+TXV	G*VC80805D*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	8.5	15,000	750	9924168
	CHPF3743C6B*+TXV	G*VC80805C*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	9.0	15,000	810	5038625
	CHPF3743C6B*+TXV	G*VC81005C*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	9.0	15,000	810	5038680
	CHPF3743C6B*+TXV	A*VC80805C*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	9.0	15,000	810	5038739
	CHPF3743C6B*+TXV	A*VC81005C*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	9.0	15,000	810	5038780
	CHPF3743C6B*+TXV	G*VC80805D*B*	24,000	19,000	16.0	12.0	23,200	18,600	24,000	8.5	15,000	750	9924169
	CHPF3743D6B*+MBVC1600**~1A*+TXV		24,000	19,000	16.0	12.5	23,200	18,600	23,000	9.2	15,000	850	3654519
DSZC16 0361A*	AVPTC37C14A*		34,600	26,200	15.0	12.0	33,400	25,800	34,400	8.5	20,000	1,130	9116213
	AVPTC37D14A*		34,600	26,200	16.0	12.5	33,400	25,800	34,400	9.0	21,000	1,245	8996212
	AVPTC42D14A*		34,600	26,200	16.0	12.5	33,400	25,800	34,400	9.2	21,000	1,200	5933258
	AVPTC48D14A*		36,000	27,400	16.0	12.5	34,800	26,800	34,400	9.2	21,000	1,200	5933259
	CA*F3642*6D*+MBVC1600**~1A*+TXV		34,600	26,200	16.0	12.5	33,400	25,800	34,400	9.2	21,000	1,200	6498031
	CA*F3743*6D*+MBVC2000**~1A*+TXV		34,600	26,200	16.0	12.5	33,400	25,800	34,400	9.2	21,000	1,200	4415184
	CA*F3743*6D*+TXV	G*VC80805C*B*	34,200	26,000	15.0	12.0	33,000	25,400	34,000	9.2	20,400	1,080	5038627
	CA*F3743*6D*+TXV	G*VC80604B*B*	34,200	26,000	15.5	11.5	33,000	25,400	34,000	9.2	21,000	1,260	5038632
	CA*F3743*6D*+TXV	A*VC80603B*B*	34,200	26,000	15.5	11.5	33,000	25,400	34,000	9.2	21,000	1,170	5038741
	CA*F3743*6D*+TXV	A*VC80805C*B*	34,200	26,000	15.0	12.0	33,000	25,400	34,000	9.2	20,400	1,080	5038742
	CA*F3743*6D*+TXV	ADVC80805C*B*	34,200	26,000	15.0	12.0	33,000	25,400	34,000	9.2	20,400	1,090	5038743
	CA*F3743*6D*+TXV	A*VC80604B*B*	34,200	26,000	15.5	11.5	33,000	25,400	34,000	9.2	21,000	1,260	5038751
	CA*F3743*6D*+TXV	A*VC81005C*B*	34,600	26,200	15.0	12.0	33,400	25,800	34,000	9.2	20,400	1,080	6498032
	CA*F3743*6D*+TXV	ADVC81005C*B*	34,600	26,200	15.0	12.0	33,400	25,800	34,000	9.2	20,400	1,110	6498043
	CA*F3743*6D*+TXV	G*VC81005C*B*	34,600	26,200	15.0	12.0	33,400	25,800	34,000	9.2	20,400	1,080	6498044
	CA*F3743*6D*+TXV	G*VC960403BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360639
	CA*F3743*6D*+TXV	G*VC960603BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360642
	CA*F3743*6D*+TXV	G*VC960803BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360645
	CA*F3743*6D*+TXV	G*VC960804CNA*	34,600	26,200	15.5	12.5	33,400	25,800	34,000	9.0	21,000	1,200	7360648
	CA*F3743*6D*+TXV	G*VM970603BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360665
	CA*F3743*6D*+TXV	G*VM970803BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360668
	CA*F3743*6D*+TXV	G*VM970804CNA*	34,600	26,200	15.5	12.5	33,400	25,800	34,000	9.0	21,000	1,200	7360671
	CA*F3743*6D*+TXV	A*VC960403BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360691
	CA*F3743*6D*+TXV	A*VC960603BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360694
	CA*F3743*6D*+TXV	A*VC960803BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360697
	CA*F3743*6D*+TXV	A*VC960804CNA*	34,600	26,200	15.5	12.5	33,400	25,800	34,000	9.0	21,000	1,200	7360700
	CA*F3743*6D*+TXV	A*VM970603BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360717
	CA*F3743*6D*+TXV	A*VM970803BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360720
	CA*F3743*6D*+TXV	A*VM970804CNA*	34,600	26,200	15.5	12.5	33,400	25,800	34,000	9.0	21,000	1,200	7360723
	CA*F3743*6D*+TXV	G*VC961005CNA*	34,600	26,200	15.5	12.5	33,400	25,800	34,000	9.0	21,000	1,200	7362544
CA*F3743*6D*+TXV	G*VM971005CNA*	34,600	26,200	15.5	12.5	33,400	25,800	34,000	9.0	21,000	1,200	7362554	
CA*F3743*6D*+TXV	A*VC961005CNA*	34,600	26,200	15.5	12.5	33,400	25,800	34,000	9.0	21,000	1,200	7362566	

See Notes on Page 29.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS [^]				TVA RATINGS ³		HEATING RATINGS [^]			CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL	SENS.	SEER ¹	EER ²	TOTAL	SENS.	Hi ⁴	HSPF ⁵	Low ⁶		
DSZC16 0361A* (Contd.)	CA*F3743*6D*+TXV	A*VM971005CNA*	34,600	26,200	15.5	12.5	33,400	25,800	34,000	9.0	21,000	1,200	7362577
	CA*F3743*6D*+TXV	G*EC960603BNA*	34,600	26,200	15.0	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7368141
	CA*F3743*6D*+TXV	G*EC960803BNA*	34,600	26,200	15.0	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7368144
	CA*F3743*6D*+TXV	G*EC961004CNA*	34,600	26,200	15.5	12.5	33,400	25,800	34,000	9.0	21,000	1,250	7368147
	CA*F3743*6D*+TXV	A*EC960603BNA*	34,600	26,200	15.0	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7368176
	CA*F3743*6D*+TXV	A*EC960803BNA*	34,600	26,200	15.0	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7368179
	CA*F3743*6D*+TXV	A*EC961004CNA*	34,600	26,200	15.5	12.5	33,400	25,800	34,000	9.0	21,000	1,250	7368182
	CA*F3743*6D*+TXV	G*VC80803B*B*	34,200	26,000	15.0	12.0	33,000	25,400	34,000	9.0	20,400	1,150	9924171
	CA*F3743*6D*+TXV	G*VC80804C*B*	34,200	26,000	15.5	11.5	33,000	25,400	34,000	9.0	21,000	1,250	9924174
	CA*F3743*6D*+TXV	G*VC80805D*B*	34,200	26,000	15.0	12.0	33,000	25,400	34,000	9.0	20,400	1,200	9924178
	CA*F4860*6D*+MBVC1600**_1A*+TXV		35,000	26,600	16.0	12.5	33,800	26,000	34,400	9.2	21,000	1,200	3880756
	CA*F4860*6D*+MBVC2000**_1A*+TXV		35,000	26,600	16.0	12.5	33,800	26,000	34,400	9.2	21,000	1,200	3880762
	CA*F4860*6D*+TXV	G*VC80805C*B*	35,000	26,600	15.5	12.0	33,800	26,000	34,000	9.2	20,400	1,080	5038667
	CA*F4860*6D*+TXV	G*VC80604B*B*	35,000	26,600	15.5	11.5	33,800	26,000	34,000	9.2	21,000	1,260	5038681
	CA*F4860*6D*+TXV	ADV80805C*B*	35,000	26,600	15.5	12.0	33,800	26,000	34,000	9.2	20,400	1,090	5038744
	CA*F4860*6D*+TXV	A*VC80603B*B*	34,600	26,200	15.5	12.0	33,400	25,800	34,000	9.2	21,000	1,170	5038752
	CA*F4860*6D*+TXV	A*VC80805C*B*	35,000	26,600	15.5	12.0	33,800	26,000	34,000	9.2	20,400	1,080	5038771
	CA*F4860*6D*+TXV	A*VC80604B*B*	35,000	26,600	15.5	11.5	33,800	26,000	34,000	9.2	21,000	1,260	5038781
	CA*F4860*6D*+TXV	A*VC81005C*B*	35,000	26,600	15.0	12.0	33,800	26,000	34,000	9.2	20,400	1,080	6498045
	CA*F4860*6D*+TXV	ADV81005C*B*	35,000	26,600	15.0	12.0	33,800	26,000	34,000	9.2	20,400	1,110	6498054
	CA*F4860*6D*+TXV	G*VC81005C*B*	35,000	26,600	15.0	12.0	33,800	26,000	34,000	9.2	20,400	1,080	6498055
	CA*F4860*6D*+TXV	G*VC960403BNA*	35,000	26,600	15.5	11.5	33,800	26,000	34,000	9.0	21,000	1,150	7360640
	CA*F4860*6D*+TXV	G*VC960603BNA*	35,000	26,600	15.5	11.5	33,800	26,000	34,000	9.0	21,000	1,150	7360643
	CA*F4860*6D*+TXV	G*VC960803BNA*	35,000	26,600	15.5	11.5	33,800	26,000	34,000	9.0	21,000	1,150	7360646
	CA*F4860*6D*+TXV	G*VC960804CNA*	35,000	26,600	15.5	12.5	33,800	26,000	34,000	9.0	21,000	1,200	7360649
	CA*F4860*6D*+TXV	G*VM970603BNA*	35,000	26,600	15.5	11.5	33,800	26,000	34,000	9.0	21,000	1,150	7360666
	CA*F4860*6D*+TXV	G*VM970803BNA*	35,000	26,600	15.5	11.5	33,800	26,000	34,000	9.0	21,000	1,150	7360669
	CA*F4860*6D*+TXV	G*VM970804CNA*	35,000	26,600	15.5	12.5	33,800	26,000	34,000	9.0	21,000	1,200	7360672
	CA*F4860*6D*+TXV	A*VC960403BNA*	35,000	26,600	15.5	11.5	33,800	26,000	34,000	9.0	21,000	1,150	7360692
	CA*F4860*6D*+TXV	A*VC960603BNA*	35,000	26,600	15.5	11.5	33,800	26,000	34,000	9.0	21,000	1,150	7360695
	CA*F4860*6D*+TXV	A*VC960803BNA*	35,000	26,600	15.5	11.5	33,800	26,000	34,000	9.0	21,000	1,150	7360698
	CA*F4860*6D*+TXV	A*VC960804CNA*	35,000	26,600	15.5	12.5	33,800	26,000	34,000	9.0	21,000	1,200	7360701
	CA*F4860*6D*+TXV	A*VM970603BNA*	35,000	26,600	15.5	11.5	33,800	26,000	34,000	9.0	21,000	1,150	7360718
	CA*F4860*6D*+TXV	A*VM970803BNA*	35,000	26,600	15.5	11.5	33,800	26,000	34,000	9.0	21,000	1,150	7360721
	CA*F4860*6D*+TXV	A*VM970804CNA*	35,000	26,600	15.5	12.5	33,800	26,000	34,000	9.0	21,000	1,200	7360724
	CA*F4860*6D*+TXV	G*VC961005CNA*	35,000	26,600	15.5	12.5	33,800	26,000	34,000	9.0	21,000	1,200	7362545
	CA*F4860*6D*+TXV	G*VM971005CNA*	35,000	26,600	15.5	12.5	33,800	26,000	34,000	9.0	21,000	1,200	7362556
	CA*F4860*6D*+TXV	A*VC961005CNA*	35,000	26,600	15.5	12.5	33,800	26,000	34,000	9.0	21,000	1,200	7362568
	CA*F4860*6D*+TXV	A*VM971005CNA*	35,000	26,600	15.5	12.5	33,800	26,000	34,000	9.0	21,000	1,200	7362578
	CA*F4860*6D*+TXV	G*EC960603BNA*	35,000	26,600	15.0	11.5	33,800	26,000	34,000	9.0	21,000	1,150	7368142
	CA*F4860*6D*+TXV	G*EC960803BNA*	35,000	26,600	15.0	11.5	33,800	26,000	34,000	9.0	21,000	1,150	7368145
	CA*F4860*6D*+TXV	G*EC961004CNA*	35,000	26,600	15.5	12.5	33,800	26,000	34,000	9.0	21,000	1,250	7368148
	CA*F4860*6D*+TXV	A*EC960603BNA*	35,000	26,600	15.0	11.5	33,800	26,000	34,000	9.0	21,000	1,150	7368177
	CA*F4860*6D*+TXV	A*EC960803BNA*	35,000	26,600	15.0	11.5	33,800	26,000	34,000	9.0	21,000	1,150	7368180
	CA*F4860*6D*+TXV	A*EC961004CNA*	35,000	26,600	15.5	12.5	33,800	26,000	34,000	9.0	21,000	1,250	7368183
	CA*F4860*6D*+TXV	G*VC80803B*B*	35,000	26,600	15.5	12.0	33,800	26,000	34,000	9.0	20,400	1,150	9924172
	CA*F4860*6D*+TXV	G*VC80804C*B*	35,000	26,600	16.0	12.0	33,800	26,000	34,000	9.0	21,000	1,250	9924175
	CA*F4860*6D*+TXV	G*VC80805D*B*	35,000	26,600	15.5	12.0	33,800	26,000	34,000	9.0	20,400	1,200	9924179
	CAPT3743*4A*+MBVC1600**_1A*		34,600	26,200	15.0	12.5	33,400	25,800	34,400	8.5	21,000	1,200	8538631
	CAPT3743*4A*+MBVC2000**_1A*		35,000	26,600	15.0	12.5	33,800	26,000	35,000	8.5	21,000	1,200	8669662
CAPT4961*4A*	G*VC961005CNA*	34,600	26,200	16.0	12.5	33,400	25,800	34,400	9.0	21,000	1,200	8537216	
CHPF3636B6C*+TXV	A*VC80604B*B*	34,000	25,800	14.5	12.0	32,800	25,200	34,000	8.5	20,000	1,220	6498056	

See Notes on Page 29.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS ^				TVA RATINGS ^3		HEATING RATINGS ^			CFM	AHRI #	
	COILS/AIR HANDLERS	FURNACES	TOTAL	SENS.	SEER ^1	EER ^2	TOTAL	SENS.	Hi ^4	HSPF ^5	Low ^6			
DSZC16 0361A* (Contd.)	CHPF3642C6C*+MBVC1600**-.1A*+TXV		34,600	26,200	16.0	12.5	33,400	25,800	34,400	9.2	21,000	1,200	3654592	
	CHPF3642D6C*+MBVC2000**-.1A*+TXV		34,600	26,200	16.0	12.5	33,400	25,800	34,400	9.2	21,000	1,200	3654594	
	CHPF3743C6B*+MBVC1600**-.1A*+TXV		34,600	26,200	16.0	12.5	33,400	25,800	34,400	9.2	21,000	1,200	3654600	
	CHPF3743C6B*+TXV	G*VC80805C*B*	35,000	26,600	15.0	12.0	33,800	26,000	34,000	9.2	20,400	1,080	5038634	
	CHPF3743C6B*+TXV	G*VC80604B*B*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.2	21,000	1,260	5038696	
	CHPF3743C6B*+TXV	A*VC80805C*B*	35,000	26,600	15.0	12.0	33,800	26,000	34,000	9.2	20,400	1,080	5038753	
	CHPF3743C6B*+TXV	A*VC80604B*B*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.2	21,000	1,260	5038791	
	CHPF3743C6B*+TXV	A*VC81005C*B*	34,600	26,200	15.0	12.0	33,400	25,800	34,000	9.2	20,400	1,080	6498057	
	CHPF3743C6B*+TXV	G*VC81005C*B*	34,600	26,200	15.0	12.0	33,400	25,800	34,000	9.2	20,400	1,080	6498066	
	CHPF3743C6B*+TXV	G*VC960403BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360641	
	CHPF3743C6B*+TXV	G*VC960603BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360644	
	CHPF3743C6B*+TXV	G*VC960803BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360647	
	CHPF3743C6B*+TXV	G*VM970603BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360667	
	CHPF3743C6B*+TXV	G*VM970803BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360670	
	CHPF3743C6B*+TXV	A*VC960403BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360693	
	CHPF3743C6B*+TXV	A*VC960603BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360696	
	CHPF3743C6B*+TXV	A*VC960803BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360699	
	CHPF3743C6B*+TXV	A*VM970603BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360719	
	CHPF3743C6B*+TXV	A*VM970803BNA*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7360722	
	CHPF3743C6B*+TXV	G*EC960603BNA*	34,600	26,200	15.0	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7368143	
	CHPF3743C6B*+TXV	G*EC960803BNA*	34,600	26,200	15.0	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7368146	
	CHPF3743C6B*+TXV	A*EC960603BNA*	34,600	26,200	15.0	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7368178	
	CHPF3743C6B*+TXV	A*EC960803BNA*	34,600	26,200	15.0	11.5	33,400	25,800	34,000	9.0	21,000	1,150	7368181	
	CHPF3743C6B*+TXV	G*VC80603B*B*	34,600	26,200	15.0	12.0	33,400	25,800	34,000	9.0	20,400	1,100	9924170	
	CHPF3743C6B*+TXV	G*VC80803B*B*	34,600	26,200	15.0	12.0	33,400	25,800	34,000	9.0	20,400	1,150	9924173	
	CHPF3743C6B*+TXV	G*VC80804C*B*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,250	9924176	
	CHPF3743C6B*+TXV	G*VC80805D*B*	35,000	26,600	15.0	12.0	33,800	26,000	34,000	9.0	20,400	1,200	9924180	
	CHPF3743D6B*+MBVC2000**-.1A*+TXV		34,600	26,200	16.0	12.5	33,400	25,800	34,400	9.2	21,000	1,200	3654615	
	CHPF3743D6B*+TXV	G*VC80604B*B*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.2	21,000	1,260	5038604	
	CHPF3743D6B*+TXV	G*VC80805C*B*	34,200	26,000	15.5	12.0	33,000	25,400	34,000	9.2	20,400	1,080	5038682	
	CHPF3743D6B*+TXV	A*VC80604B*B*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.2	21,000	1,260	5038726	
	CHPF3743D6B*+TXV	A*VC80805C*B*	34,200	26,000	15.5	12.0	33,000	25,400	34,000	9.2	20,400	1,080	5038783	
	CHPF3743D6B*+TXV	A*VC81005C*B*	34,600	26,200	15.0	12.0	33,400	25,800	34,000	9.2	20,400	1,080	6498067	
	CHPF3743D6B*+TXV	G*VC81005C*B*	34,600	26,200	15.0	12.0	33,400	25,800	34,000	9.2	20,400	1,080	6498076	
	CHPF3743D6B*+TXV	G*EC961004CNA*	34,600	26,200	15.5	12.5	33,400	25,800	34,000	9.0	21,000	1,250	7368149	
	CHPF3743D6B*+TXV	A*EC961004CNA*	34,600	26,200	15.5	12.5	33,400	25,800	34,000	9.0	21,000	1,250	7368184	
	CHPF3743D6B*+TXV	G*VC80804C*B*	34,600	26,200	15.5	11.5	33,400	25,800	34,000	9.0	21,000	1,250	9924177	
	CHPF3743D6B*+TXV	G*VC80805D*B*	34,200	26,000	15.5	12.0	33,000	25,400	34,000	9.0	20,400	1,200	9924181	
	CHPF4860D6D*+TXV	G*VC960804CNA*	35,000	26,600	15.5	12.5	33,800	26,000	34,000	9.0	21,000	1,200	7360650	
	CHPF4860D6D*+TXV	G*VM970804CNA*	35,000	26,600	15.5	12.5	33,800	26,000	34,000	9.0	21,000	1,200	7360673	
	CHPF4860D6D*+TXV	A*VC960804CNA*	35,000	26,600	15.5	12.5	33,800	26,000	34,000	9.0	21,000	1,200	7360702	
	CHPF4860D6D*+TXV	A*VM970804CNA*	35,000	26,600	15.5	12.5	33,800	26,000	34,000	9.0	21,000	1,200	7360725	
	CHPF4860D6D*+TXV	G*VC961005CNA*	35,000	26,600	15.5	12.5	33,800	26,000	34,000	9.0	21,000	1,200	7362547	
	CHPF4860D6D*+TXV	G*VM971005CNA*	35,000	26,600	15.5	12.5	33,800	26,000	34,000	9.0	21,000	1,200	7362557	
	CHPF4860D6D*+TXV	A*VC961005CNA*	35,000	26,600	15.5	12.5	33,800	26,000	34,000	9.0	21,000	1,200	7362569	
	CHPF4860D6D*+TXV	A*VM971005CNA*	35,000	26,600	15.5	12.5	33,800	26,000	34,000	9.0	21,000	1,200	7362580	
	DSZC16 0481A*	AVPTC48D14A*		46,000	35,600	15.5	12.0	44,400	34,800	46,000	9.2	34,000	1,550	5933260
		AVPTC61D14A*		46,500	36,000	16.0	12.0	44,800	35,200	46,000	9.0	34,000	1,450	8996213
CA*F4961*6D*+MBVC1600**-.1A*+TXV		47,000	36,400	15.5	12.5	45,400	35,600	47,000	9.2	34,000	1,550	4431870		
CA*F4961*6D*+TXV		G*VC81005C*B*	47,500	36,800	15.5	12.0	45,800	36,000	46,000	9.2	30,000	1,610	5589999	
CA*F4961*6D*+TXV		A*VC80805C*B*	47,000	36,400	15.5	12.0	45,400	35,600	46,000	9.2	30,000	1,510	6498085	
CA*F4961*6D*+TXV		A*VC81005C*B*	47,500	36,800	15.5	12.0	45,800	36,000	46,000	9.2	30,000	1,610	6498086	

See Notes on Page 29.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS [^]				TVA RATINGS ³		HEATING RATINGS [^]			CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL	SENS.	SEER ¹	EER ²	TOTAL	SENS.	Hi ⁴	HSPF ⁵	Low ⁶		
DSZC16 0481A* (Contd.)	CA*F4961*6D*+TXV	ADVC80805C*B*	47,000	36,400	15.5	12.0	45,400	35,600	46,000	9.2	30,000	1,500	6498095
	CA*F4961*6D*+TXV	ADVC81005C*B*	47,500	36,800	15.5	12.0	45,800	36,000	46,000	9.2	30,000	1,620	6498096
	CA*F4961*6D*+TXV	G*VC80805C*B*	47,000	36,400	15.5	12.0	45,400	35,600	46,000	9.2	30,000	1,510	6498097
	CA*F4961*6D*+TXV	G*VC960804CNA*	47,000	36,400	15.5	12.5	45,400	35,600	47,000	9.0	32,000	1,600	7360651
	CA*F4961*6D*+TXV	G*VC961005CNA*	47,000	36,400	15.0	12.0	45,400	35,600	47,000	9.0	32,000	1,550	7360653
	CA*F4961*6D*+TXV	G*VC961205DNA*	47,000	36,400	16.0	12.5	45,400	35,600	47,000	9.0	32,000	1,600	7360655
	CA*F4961*6D*+TXV	G*VM970804CNA*	47,000	36,400	15.5	12.5	45,400	35,600	47,000	9.0	32,000	1,600	7360674
	CA*F4961*6D*+TXV	G*VM971005CNA*	47,000	36,400	15.0	12.0	45,400	35,600	47,000	9.0	32,000	1,550	7360676
	CA*F4961*6D*+TXV	G*VM971205DNA*	47,000	36,400	16.0	12.5	45,400	35,600	47,000	9.0	32,000	1,600	7360678
	CA*F4961*6D*+TXV	A*VC960804CNA*	47,000	36,400	15.5	12.5	45,400	35,600	47,000	9.0	32,000	1,600	7360703
	CA*F4961*6D*+TXV	A*VC961005CNA*	47,000	36,400	15.0	12.0	45,400	35,600	47,000	9.0	32,000	1,550	7360705
	CA*F4961*6D*+TXV	A*VC961205DNA*	47,000	36,400	16.0	12.5	45,400	35,600	47,000	9.0	32,000	1,600	7360707
	CA*F4961*6D*+TXV	A*VM970804CNA*	47,000	36,400	15.5	12.5	45,400	35,600	47,000	9.0	32,000	1,600	7360726
	CA*F4961*6D*+TXV	A*VM971005CNA*	47,000	36,400	15.0	12.0	45,400	35,600	47,000	9.0	32,000	1,550	7360728
	CA*F4961*6D*+TXV	A*VM971205DNA*	47,000	36,400	16.0	12.5	45,400	35,600	47,000	9.0	32,000	1,600	7360730
	CA*F4961*6D*+TXV	G*EC961004CNA*	47,000	36,400	15.0	12.0	45,400	35,600	47,000	9.0	32,000	1,550	7368150
	CA*F4961*6D*+TXV	G*EC961205DNA*	47,000	36,400	15.0	12.0	45,400	35,600	47,000	9.0	32,000	1,520	7368152
	CA*F4961*6D*+TXV	A*EC961004CNA*	47,000	36,400	15.0	12.0	45,400	35,600	47,000	9.0	32,000	1,550	7368185
	CA*F4961*6D*+TXV	A*EC961205DNA*	47,000	36,400	15.0	12.0	45,400	35,600	47,000	9.0	32,000	1,520	7368187
	CA*F4961*6D*+TXV	G*VC80805D*B*	47,000	36,400	15.5	12.0	45,400	35,600	46,000	9.0	30,000	1,500	9924182
	CAPT4961*4A*+MBVC2000**-.1A*		47,000	36,400	15.5	13.0	45,400	35,600	46,500	9.0	29,400	1,600	8495552
	CHPF4860D6D*+MBVC2000**-.1A*+TXV		47,500	36,800	16.0	12.5	45,800	36,000	47,000	9.2	34,000	1,550	3654680
	CHPF4860D6D*+TXV	A*VC80805C*B*	47,500	36,800	15.5	12.0	45,800	36,000	46,000	9.2	30,000	1,510	5265336
	CHPF4860D6D*+TXV	A*VC81005C*B*	47,500	36,800	15.5	12.0	45,800	36,000	46,000	9.2	30,000	1,610	5265337
	CHPF4860D6D*+TXV	G*VC80805C*B*	47,500	36,800	15.5	12.0	45,800	36,000	46,000	9.2	30,000	1,510	6498106
	CHPF4860D6D*+TXV	G*VC81005C*B*	47,500	36,800	15.5	12.0	45,800	36,000	46,000	9.2	30,000	1,610	6498107
	CHPF4860D6D*+TXV	G*VC960804CNA*	47,000	36,400	15.5	12.5	45,400	35,600	47,000	9.0	32,000	1,600	7360652
	CHPF4860D6D*+TXV	G*VC961005CNA*	47,000	36,400	15.0	12.0	45,400	35,600	47,000	9.0	32,000	1,550	7360654
	CHPF4860D6D*+TXV	G*VC961205DNA*	47,000	36,400	16.0	12.5	45,400	35,600	47,000	9.0	32,000	1,600	7360656
	CHPF4860D6D*+TXV	G*VM970804CNA*	47,000	36,400	15.5	12.5	45,400	35,600	47,000	9.0	32,000	1,600	7360675
	CHPF4860D6D*+TXV	G*VM971005CNA*	47,000	36,400	15.0	12.0	45,400	35,600	47,000	9.0	32,000	1,550	7360677
	CHPF4860D6D*+TXV	G*VM971205DNA*	47,000	36,400	16.0	12.5	45,400	35,600	47,000	9.0	32,000	1,600	7360679
	CHPF4860D6D*+TXV	A*VC960804CNA*	47,000	36,400	15.5	12.5	45,400	35,600	47,000	9.0	32,000	1,600	7360704
	CHPF4860D6D*+TXV	A*VC961005CNA*	47,000	36,400	15.0	12.0	45,400	35,600	47,000	9.0	32,000	1,550	7360706
	CHPF4860D6D*+TXV	A*VC961205DNA*	47,000	36,400	16.0	12.5	45,400	35,600	47,000	9.0	32,000	1,600	7360708
	CHPF4860D6D*+TXV	A*VM970804CNA*	47,000	36,400	15.5	12.5	45,400	35,600	47,000	9.0	32,000	1,600	7360727
	CHPF4860D6D*+TXV	A*VM971005CNA*	47,000	36,400	15.0	12.0	45,400	35,600	47,000	9.0	32,000	1,550	7360729
	CHPF4860D6D*+TXV	A*VM971205DNA*	47,000	36,400	16.0	12.5	45,400	35,600	47,000	9.0	32,000	1,600	7360731
	CHPF4860D6D*+TXV	G*EC961004CNA*	47,000	36,400	15.0	12.0	45,400	35,600	47,000	9.0	32,000	1,550	7368151
	CHPF4860D6D*+TXV	G*EC961205DNA*	47,000	36,400	15.0	12.0	45,400	35,600	47,000	9.0	32,000	1,520	7368153
CHPF4860D6D*+TXV	A*EC961004CNA*	47,000	36,400	15.0	12.0	45,400	35,600	47,000	9.0	32,000	1,550	7368186	
CHPF4860D6D*+TXV	A*EC961205DNA*	47,000	36,400	15.0	12.0	45,400	35,600	47,000	9.0	32,000	1,520	7368188	
CHPF4860D6D*+TXV	G*VC80805D*B*	47,500	36,800	15.5	12.0	45,800	36,000	46,000	9.0	30,000	1,500	9924183	
DSZC16 0601B*	AVPTC60D14A*		57,000	42,000	16.0	12.0	55,000	41,200	57,000	9.0	36,200	1,700	5933261
	AVPTC61D14A*		55,000	40,600	16.0	12.0	53,000	39,600	57,000	9.0	36,200	1,820	8996214
	CA*F4961*6D*+TXV	G*VC80805C*B*	55,000	40,600	15.5	12.0	53,000	39,600	56,000	9.1	35,400	1,580	5038635
	CA*F4961*6D*+TXV	G*VC81005C*B*	55,500	41,000	15.5	12.0	53,400	40,000	56,000	9.1	35,600	1,800	5038710
	CA*F4961*6D*+TXV	A*VC80805C*B*	55,000	40,600	15.5	12.0	53,000	39,600	56,000	9.1	35,400	1,580	5038754
	CA*F4961*6D*+TXV	ADVC80805C*B*	54,500	40,200	15.0	12.0	52,600	39,400	56,000	9.1	35,400	1,580	5038772
	CA*F4961*6D*+TXV	ADVC81005C*B*	55,500	41,000	15.5	12.0	53,400	40,000	56,000	9.1	35,600	1,820	5038792
	CA*F4961*6D*+TXV	A*VC81005C*B*	55,500	41,000	15.5	12.0	53,400	40,000	56,000	9.1	35,600	1,800	5038800
	CA*F4961*6D*+TXV	G*VC961205DNA*	55,500	41,000	15.5	12.0	53,400	40,000	56,000	9.0	35,000	1,600	7360657

See Notes on Page 29.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS ^				TVA RATINGS ³		HEATING RATINGS ^			CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL	SENS.	SEER ¹	EER ²	TOTAL	SENS.	Hi ⁴	HSPF ⁵	Low ⁶		
DSZC16 0601B* (Contd.)	CA*F4961*6D*+TXV	G*VM971205DNA*	55,500	41,000	15.5	12.0	53,400	40,000	56,000	9.0	35,000	1,600	7360680
	CA*F4961*6D*+TXV	A*VC961205DNA*	55,500	41,000	15.5	12.0	53,400	40,000	56,000	9.0	35,000	1,600	7360709
	CA*F4961*6D*+TXV	A*VM971205DNA*	55,500	41,000	15.5	12.0	53,400	40,000	56,000	9.0	35,000	1,600	7360732
	CA*F4961*6D*+TXV	G*EC961205DNA*	55,500	41,000	15.5	12.0	53,400	40,000	56,000	9.0	35,000	1,520	7368154
	CA*F4961*6D*+TXV	A*EC961205DNA*	55,500	41,000	15.5	12.0	53,400	40,000	56,000	9.0	35,000	1,520	7368189
	CA*F4961*6D*+TXV	G*VC80805D*B*	55,000	40,600	15.5	12.0	53,000	39,600	56,000	9.0	35,400	1,650	9924184
	CHPF4860D6D*+MBVC2000*-1A*+TXV		56,000	41,400	16.0	12.7	54,000	40,400	55,500	9.2	35,200	1,600	4236528
	CHPF4860D6D*+TXV	G*VC80805C*B*	55,000	40,600	15.5	12.0	53,000	39,600	55,500	9.1	35,200	1,590	5038605
	CHPF4860D6D*+TXV	G*VC81005C*B*	55,500	41,000	15.5	12.0	53,400	40,000	56,000	9.1	35,400	1,800	5038697
	CHPF4860D6D*+TXV	A*VC80805C*B*	55,000	40,600	15.5	12.0	53,000	39,600	55,500	9.1	35,200	1,590	5038727
	CHPF4860D6D*+TXV	A*VC81005C*B*	55,500	41,000	15.5	12.0	53,400	40,000	56,000	9.1	35,400	1,800	5038793
	CHPF4860D6D*+TXV	G*VC961205DNA*	55,000	40,600	15.5	12.0	53,000	39,600	56,000	9.0	35,000	1,600	7360658
	CHPF4860D6D*+TXV	G*VM971205DNA*	55,000	40,600	15.5	12.0	53,000	39,600	56,000	9.0	35,000	1,600	7360681
	CHPF4860D6D*+TXV	A*VC961205DNA*	55,000	40,600	15.5	12.0	53,000	39,600	56,000	9.0	35,000	1,600	7360710
	CHPF4860D6D*+TXV	A*VM971205DNA*	55,000	40,600	15.5	12.0	53,000	39,600	56,000	9.0	35,000	1,600	7360733
	CHPF4860D6D*+TXV	G*EC961205DNA*	55,000	40,600	15.0	12.0	53,000	39,600	56,000	9.0	35,000	1,520	7368155
	CHPF4860D6D*+TXV	A*EC961205DNA*	55,000	40,600	15.0	12.0	53,000	39,600	56,000	9.0	35,000	1,520	7368190
	CHPF4860D6D*+TXV	G*VC80805D*B*	55,000	40,600	15.5	12.0	53,000	39,600	55,500	9.0	35,200	1,650	9924185

^ Rated in accordance with ANSI/AHRI Standard 210/240

¹ Seasonal Energy Efficiency Ratio

² Energy Efficiency Ratio @ 80°F/ 67°F/ 95°F

³ TVA Rating: BTU/h @ 75°F/ 63°F - 95°F

⁴ Rated heating capacity at 47°F outdoor per AHRI 210/240

⁵ HSPF = Heating Seasonal Performance Factor


⁶ Heating capacity at 17°F outdoor

⁷ CFM at High stage

⁸ CFM at Intermediate and low stage

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- When matching outdoor unit to indoor unit, use the piston supplied with the outdoor unit or that specified on the piston kit chart supplied with the indoor unit.
- EEP - Order from Service Dept. Part No. B13707-38 or new Solid State Board B13707-35S. Part No. B13707-38 is not interchangeable with B13707-35S. The Amana® Distinctions® brand gas furnace contains the EEP cooling time delay.




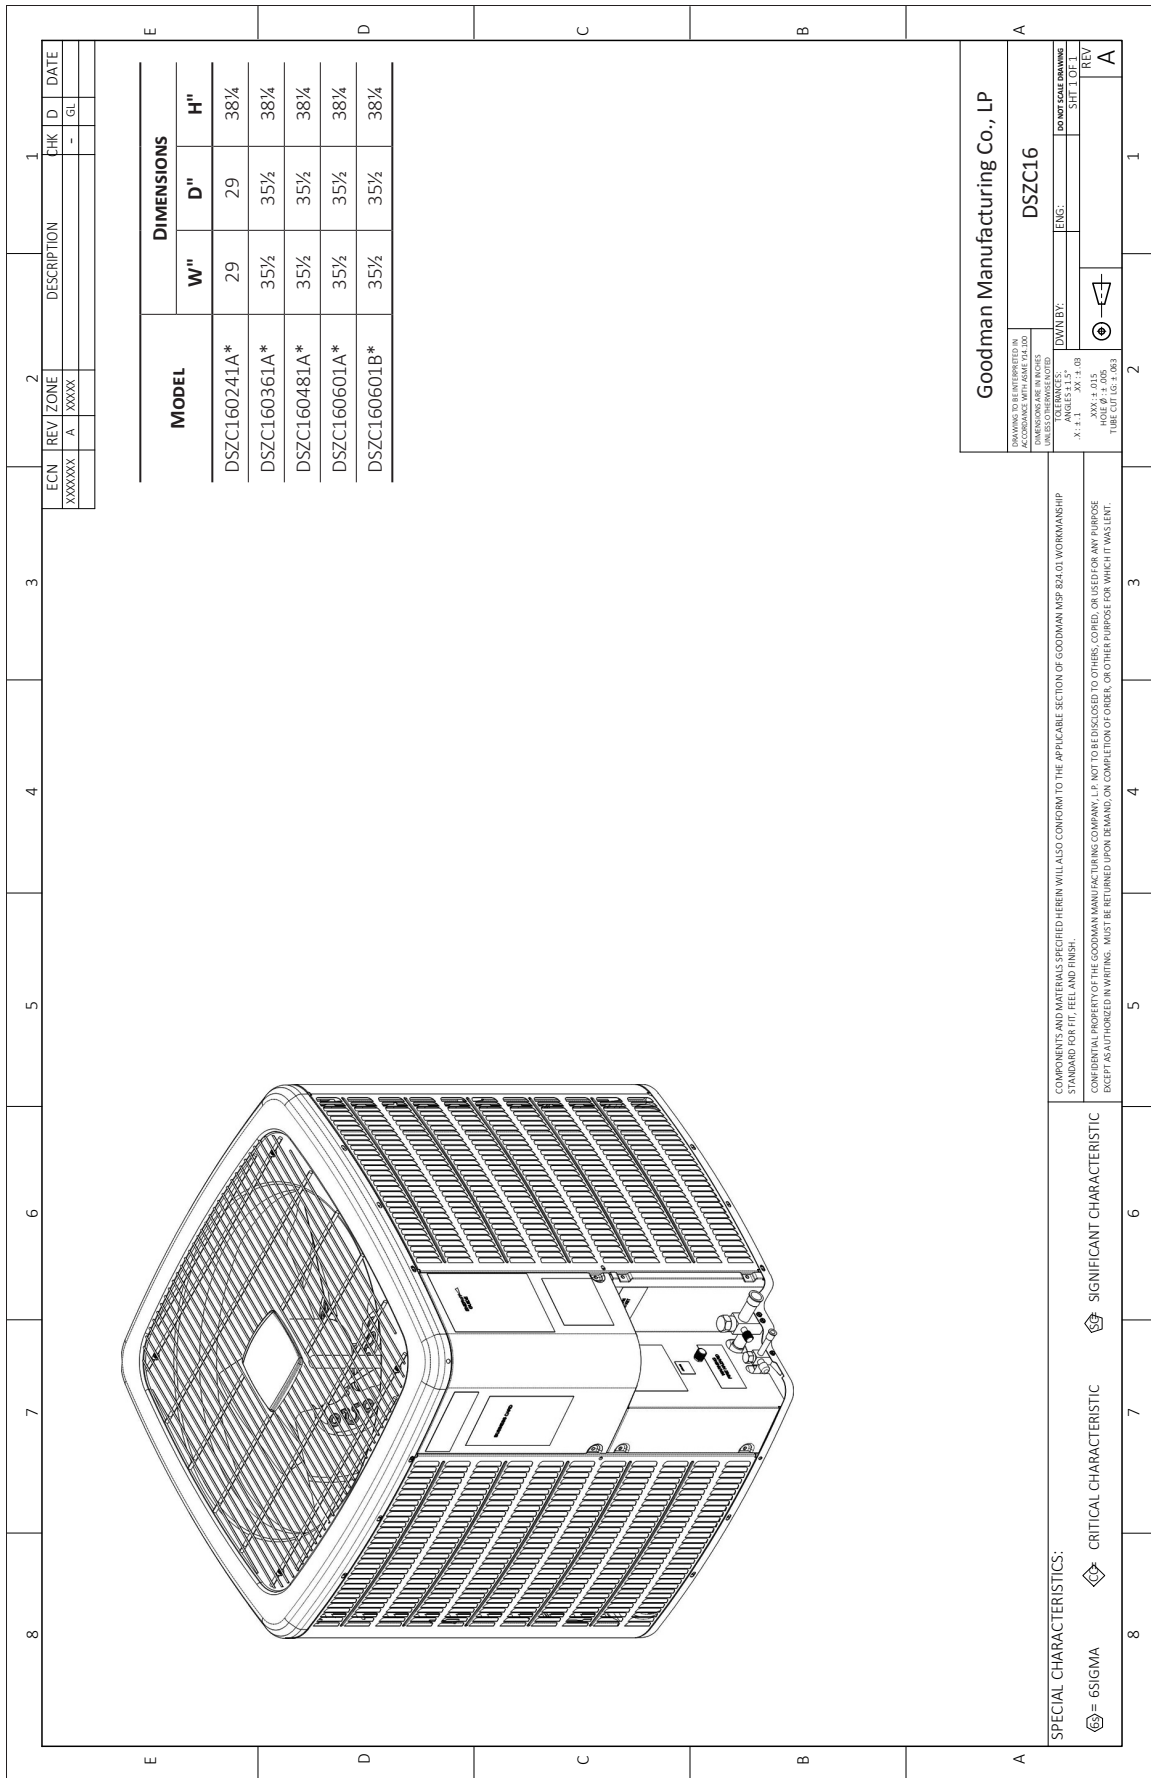


Goodman Manufacturing Co., LP

DRAWING TITLE AND NUMBER DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED		DSZC16	
DESIGNED BY	DRAWN BY	ENG	DATE
TOLERANCES ARE: X .1 XX .015 XXX .015 HOLE Ø .015 TUBE CUT TO .003		DO NOT SCALE DRAWING SHEET 1 OF 1	
REV			A

COMPONENTS AND MATERIALS SPECIFIED HEREIN WILL ALSO CONFORM TO THE APPLICABLE SECTION OF GOODMAN MSP 824.01 WORKMANSHIP STANDARD FOR FIT, FEEL AND FINISH.
CONFIDENTIAL PROPERTY OF THE GOODMAN MANUFACTURING COMPANY, L.P. NOT TO BE REPRODUCED TO OTHERS, COPIED, OR REPRODUCED IN ANY MANNER EXCEPT AS AUTHORIZED IN WRITING. MUST BE RETURNED UPON DEMAND, ON COMPLETION OF ORDER, OR OTHER PURPOSE FOR WHICH IT WAS LENT.

SPECIAL CHARACTERISTICS:
 ⊕ = SIGMA
 ⊕ = CRITICAL CHARACTERISTIC
 ⊕ = SIGNIFICANT CHARACTERISTIC

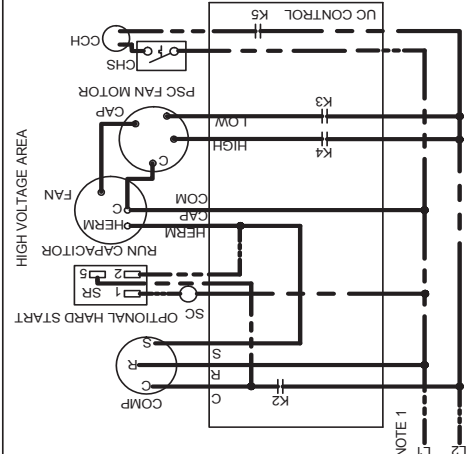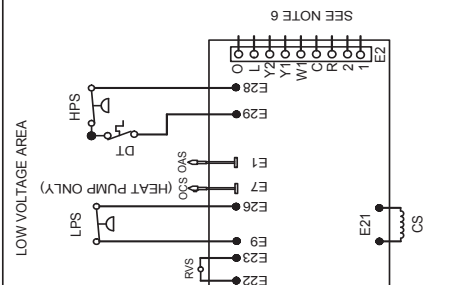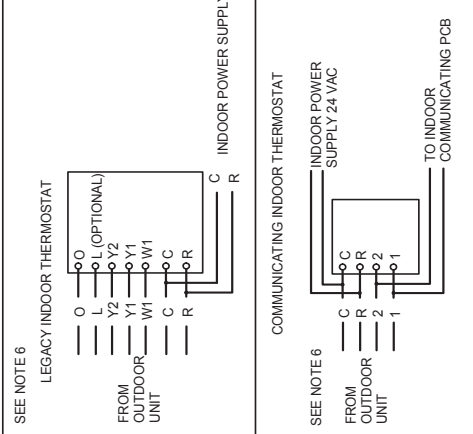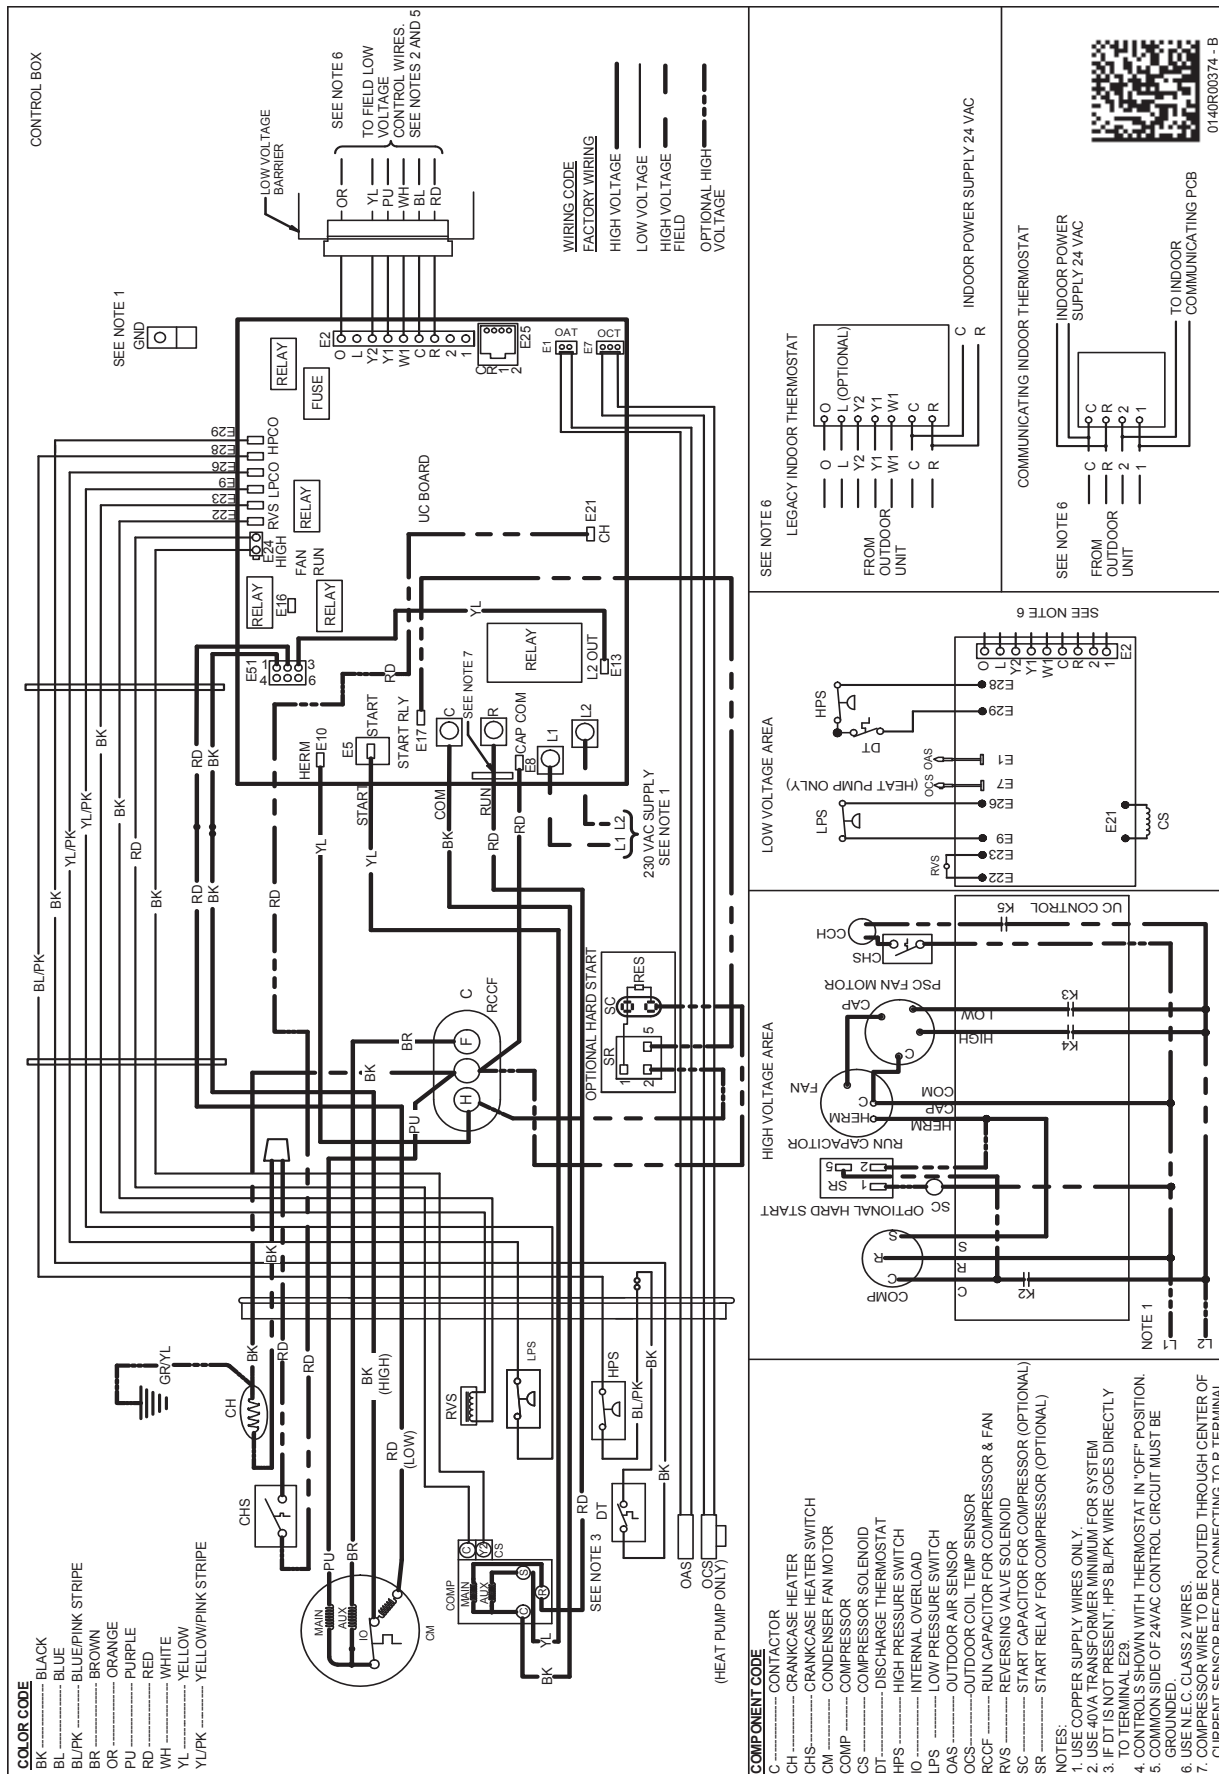

NOTE 1
 1. USE COPPER SUPPLY WIRES ONLY.
 2. USE 40VA TRANSFORMER MINIMUM FOR SYSTEM.
 3. IF DT IS NOT PRESENT, HPS BL/PK WIRE GOES DIRECTLY TO TERMINAL E23.
 4. CONTROLS SHOWN WITH THERMOSTAT IN "OFF" POSITION.
 5. COMMON SIDE OF 24VAC CONTROL CIRCUIT MUST BE GROUNDED.
 6. USE N.E.C. CLASS 2 WIRES.
 7. COMPRESSOR WIRE TO BE ROUTED THROUGH CENTER OF CURRENT SENSOR BEFORE CONNECTING TO R TERMINAL.

WARNING

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.



0140R00374 - B

MODEL	DESCRIPTION	DSZC16 024**	DSZC16 036**	DSZC16 048**	DSZC16 060**
ABK-20	Anchor Bracket Kit [◇]				
B1141643 ¹	24V Transformer	X	X	X	X
CSR-U-1	Hard-start Kit	X			
CSR-U-2	Hard-start Kit		X		
CSR-U-3	Hard-start Kit			X	X
FSK01A ²	Freeze Protection Kit	X	X	X	X
OT18-60A ³	Outdoor Thermostat/Lockout Thermostat	X	X	X	X
TX2N4	TXV Kit				
TX2N4A	TXV Kit	X			
TX3N4	TXV Kit		X		
TX5N4	TXV Kit			X	X

◇ Contains 20 brackets; four brackets needed to anchor unit to pad

¹ Available in 24V legacy mode only. This feature is integrated in the communicating mode.

² Installed on indoor coil

³ Available in 24V legacy mode only. This feature is integrated in the communicating mode. Required for heat pump applications where ambient temperature falls below 0 °F with 50% or higher relative humidity.

Note: Maximum number of installed accessories at the same time is limited by the size of the unit's control box.