### **Model LZWSRK**


### PRODUCT SPECIFICATIONS

Elkav ezH2O® RetroFit Bottle Filling Station Kit for EZ Family Filtered Non-Refrigerated, Features shall include Antimicrobial\*, Filtered, Green Ticker™, Hands Free, Laminar Flow, Real Drain, Visual Filter Monitor. Electronic Bottle Filler Sensor activation. Product shall be Wall Mount (On Wall), for Indoor applications, serving 1 station(s). Unit shall be certified to UL 399 and CAN/CSA C22.2 No. 120.

Special Features:	Antimicrobial, Filtered, Green Ticker™, Hands Free, Laminar Flow, Real Drain, Visual Filter Monitor	
Finish:	Stainless Steel	
Power:	115V/60Hz	
Bubbler Style:	No Bubbler	
Activation by:	Electronic Bottle Filler Sensor	
Mounting Type:	Wall Mount (On Wall)	
Chilling Capacity:	Non-refrigerated	
Full Load Amps	1	
Rated Watts:	15	
Dimensions (L x W x H):	17-7/8" x 3-9/16" x 18-7/8"	
Approx. Shipping Weight:	22 lbs.	
Installation Location:	Indoor	
No. of Stations Served:	1	

Special Note: Need product compatibility info? Find retrofit compatibility guide under the product downloads section.

- Visual Filter Monitor: LED Filter Status Indicator for when filter change is necessary.
- Filter is certified to NSF 42 and 53 for lead, cyst, particulate, chlorine, taste and odor reduction. 3,000 gal. capacity.
- Green Ticker: Informs user of number of 20 oz. plastic water bottles saved from waste.
- Laminar flow provides clean fill with minimal splash.
- Key plastic components are manufactured with silver ion antimicrobial agent helping to provide clean, stain- and odor-free surfaces.
- Real Drain System eliminates standing water.

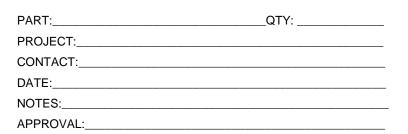



Included with Product:

Retrofit Bottle Filler. Basin with Drain Assy,

**Filter** 

#### Ships in one box.

A Century of Tradition and Quality. For more than 100 years, Elkay has been making innovative products and providing exceptional customer care. We take pride in offering plumbing products that make life easier, inspire change and leave the world a better place.



#### PRODUCT COMPLIANCE

ADA & ICC A117.1 CAN/CSA C22.2 No. 120

GreenSpec®

NSF/ANSI 42, 53, 61 (Q≤1), & 372 (lead free) **UL 399** 









Complies with ADA & ICC A117.1 accessibility requirements when installed according to the requirements outlined in these standards. Installation may require additional components and/or construction features to be fully compliant. Consult the local Authority Having Jurisdiction if necessary.

Installation Instructions (PDF) - 1000004729 Installation Instructions (PDF) - Bottle Filling Station Retrofit Kit Compatibility Guide

Electrical components and water system are warranted for 12 months from date of installation. Warranty pertains to drinking water applications only. Non-drinking water applications are not covered under warranty.

Warranty (PDF)

<sup>\*</sup>Antimicrobial claims are in refence to components manufactured antimicrobial agents, helping to provide clean, stain- and odor-free surfaces.



MOH-IVE	ingeraleu
Model	<b>LZWSRK</b>

Optional Accessories		
<u>51300C</u>	Elkay WaterSentry Replacement Filter (Bottle Fillers & Liv Pro)  Spec Sheet (PDF)	
WSF6000R-2PK	WaterSentry 6000 CTO Replacement Filter (2pack)  Spec Sheet (PDF)	

**Model LZWSRK** 

#### **IMPORTANT! INSTALLER PLEASE NOTE:**

This water cooler has been designed and built to provide water to the user which has not been altered by materials in the cooler waterways. The grounding of electrical equipment such as telephone, computer, etc. to water lines is a common procedure. The grounding may be in the building but may also occur away from the building. This grounding can cause electrical feedback into a water cooler creating an electrolysis which creates a metallic taste or causes an increase in the metal content of the water This condition is avoidable by installing the cooler using the proper materials as shown

#### NOTICE

This water cooler must be connected to the water supply using a dielectric coupling. The cooler is furnished with a non-metallic strainer which meets this requirement. The drain trap which is provided by the installer should also be plastic to completely isolate the cooler from the building plumbing system.

Bottle filler unit on bracket attached to wall by 6 holes (as shown). Water and electrical

will connect through pre-punched hole in basin.

These products are designed to operate on 20 psi to 105 psi supply line pressure.

# OPERATION OF QUICK CONNECT FITTINGS Simply push in |Tube is secured | Push in collet to tube to attach in position release tube Pushing tube in before pulling it out helps to release tube

Plus Filter System 17-7/8" WaterSentry (178mm) (178mm) SINGLE COOLER RETRO-FIT 7/16" X 3/4" (11mm X 19mm) OBROUND 3-9/16" HOLES (6) (90mm) 6-3/8' 18-7/8 6-3/8 ACTIVATION (162mm) (162mm) (479mm) (381mm) 19 (483mm) Ø 9/32" HOLES **HANGER** (7mm) BRACKET 2-7/8" (73mm) (51mm) (51mm) 51-9/16" (1310mm) (51mm) B 32-7/8" 8-1/16 F (51mm) (835mm) (205mm) ÒRIFICE 38-1/2" (979mm) D HEIGHT 28-13/16" (732mm) 31-5/16" (796mm) RIM 28-13/16 (77mm)21-7/8" (556mm) (732mm) **HEIGHT** (686mm) ADA (483mm) (51mm) REQUIREMENT 5-7/8 (150mm) 3-7/8 17-7/16' (98mm) 5-3/4" 13-15/16" (443mm) 12-1/2" (354mm) (146mm) (318mm) (178mm) (178mm) FINISHED FLOOR

#### LEGEND:

### REDUCE HEIGHT BY 3 INCHES FOR INSTALLATION OF CHILDRENS ADA COOLER

A = Recommended Water Supply location. Shut-off Valve (not furnished) to accept 3/8" O.D. unplated copper tube. Up to 3" (76mm) maximum out from wall. B = Recommended Waste Outlet location. To accommodate 1-1/4" nominal drain.

C = 1-1/4" Trap (not furnished).
D = Electrical Supply (3) Wire Recessed Box Duplex Outlet.

E = Insure proper ventilation by maintaining 6" (152mm) minimum clearance from cabinet

= 7/16" (11mm) Bolt Holes for fastening to wall.

Note: New Installations Must Use Ground Fault Circuit Interrupter (GFCI). It is highly recommended that the circuit be dedicated and the load protection be sized for 20 amps

**Model LZWSRK** 

# IMPORTANT! INSTALLER PLEASE NOTE :


This water cooler has been designed and built to provide water to the user which has not been altered by materials in the cooler waterways. The grounding of electrical equipment such as telephone, computer, etc. to water lines is a common procedure. The grounding may be in the building but may also occur away from the building. This grounding can cause electrical feedback into a water cooler creating an electrolysis which creates a metallic taste or causes an increase in the metal content of the water. This condition is avoidable by installing the cooler using the proper materials as shown

#### NOTICE


This water cooler must be connected to the water supply using a dielectric coupling. The cooler is furnished with a non-metallic strainer which meets this requirement. The drain trap which is provided by the installer should also be plastic to completely isolate the cooler from the building plumbing system.

Bottle filler unit on bracket attached to wall by 6 holes (as shown). Water and electrical will connect through pre-punched hole in basin.

These products are designed to operate on 20 psi to 105 psi supply line pressure. Simultaneous operation of both bubblers on a bi-level unit may not be possible depending on water supply pressure. If simultaneous operation is desired, please ensure a minimum of 65 psi supply.



WaterSentry® Plus Filter System

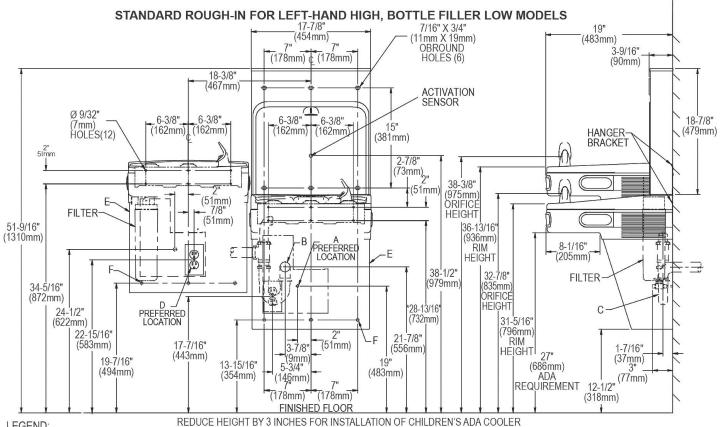

#### LEGEND:

- A = Recommended Water Supply location. Shut-off Valve (not furnished) to accept 3/8" O.D. unplated copper tube. Up to 3" (76mm) maximum out from wall. B = Recommended Waste Outlet location. To accommodate 1-1/4" nominal drain.

C = 1-1/2" Trap (not furnished).

D = Electrical Supply (3) Wire Recessed Box Duplex Outlet.
E = Insure proper ventilation by maintaining 6" (152mm) minimum clearance from cabinet
F = 7/16" (11mm) Bolt Holes for fastening to wall.

Note: New Installations Must Use Ground Fault Circuit Interrupter (GFCI). It is highly recommended that the circuit be dedicated and the load protection be sized for 20 amps.

**Model LZWSRK** 


# IMPORTANT! INSTALLER PLEASE NOTE :

This water cooler has been designed and built to provide water to the user which has not been altered by materials in the cooler waterways. The grounding of electrical equipment such as teléphone, computer, etc. to water lines is a common procedure. The grounding may be in the building but may also occur away from the building. This grounding can cause electrical feedback into a water cooler creating an electrolysis which creates a metallic taste or causes an increase in the metal content of the water. This condition is avoidable by installing the cooler using the proper materials as shown

NOTICE
This water cooler must be connected to the water supply using a dielectric coupling. The cooler is furnished with a non-metallic strainer which meets this requirement. The drain trap which is provided by the installer should also be plastic to completely isolate the cooler from the building plumbing system.


Bottle filler unit on bracket attached to wall by 6 holes (as shown). Water and electrical will connect through pre-punched hole in basin.

These products are designed to operate on 20 psi to 105 psi supply line pressure. Simultaneous operation of both bubblers on a bi-level unit may not be possible depending on water supply pressure. If simultaneous operation is desired, please ensure a minimum of 65 psi supply

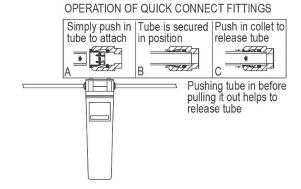

WaterSentry® Plus Filter System

ALTERNATE ROUGH-IN FOR RIGHT-HAND HIGH, BOTTLE FILLER LOW MODELS

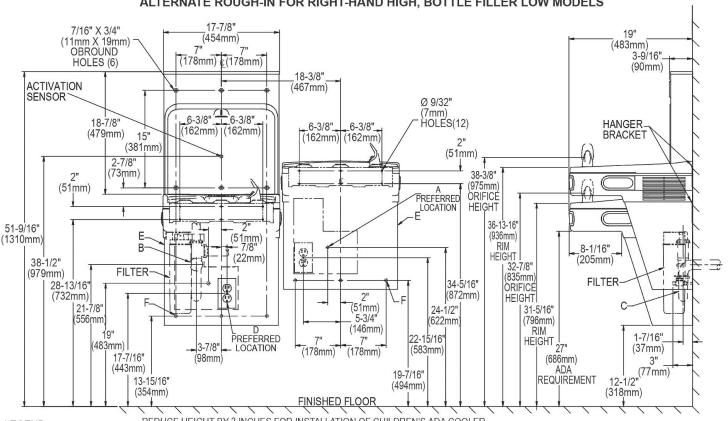

REDUCE HEIGHT BY 3 INCHES FOR INSTALLATION OF CHILDREN'S ADA COOLER

- A = Recommended Water Supply location. Shut-off Valve (not furnished) to accept 3/8" O.D. unplated copper tube. Up to 3" (76mm) maximum out from wall. B = Recommended Waste Outlet location. To accommodate 1-1/4" nominal drain.

C = 1-1/2" Trap (not furnished)

- D = Electrical Supply (3) Wire Recessed Box Duplex Outlet.
  E = Insure proper ventilation by maintaining 6" (152mm) minimum clearance from cabinet

F = 7/16" (11mm) Bolt Holes for fastening to wall

Note: New Installations Must Use Ground Fault Circuit Interrupter (GFCI). It is highly recommended that the circuit be dedicated and the load protection be sized for 20 amps.